


Water Cooled chiller cooling condenserless



EWLQ~G/L

SS (Standard Efficiency - Standard Noise) - Cooling Capacity from 87 to 347 kW
SS (Standard Efficiency - Standard Noise) - Cooling Capacity from 173 to 677 kW

Performance according to EN14511.

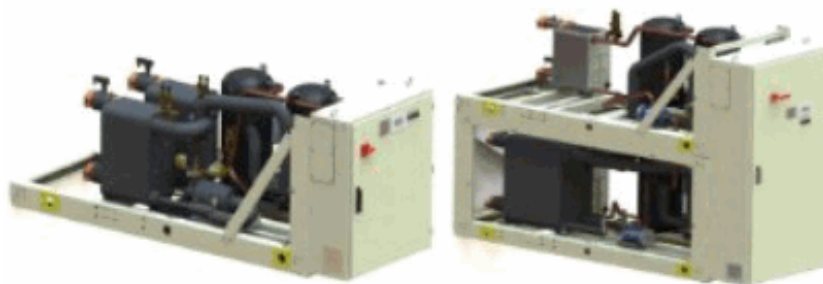

www.eurovent-certification.com
www.certiflash.com



Low operating cost and extended operating life The condenserless ranges are the result of careful design, aimed to optimize the energy efficiency of the chillers, with the objective of bringing down operating costs and improving installation profitability, effectiveness and economical management.

Flexibility The condenserless series meets all the possible request in terms of plant needs for comfort and process applications. The units are available for chilled water production. Hydronic kit, with low or high pump head, are available on request.

Wide capacity range The condenserless series covers a wide range of cooling capacities from 100 kW up to 700 kW. The introduction of the new 60 HP scroll compressor allows to reach very high capacity in the minimum space.



Wide operating range The extended operating range allows the unit to work in a very wide range of water temperatures. The electronic expansion valve (mounted as standard) guarantees a fine control of the refrigerant flow even at low condensing temperatures.



Compact Design The innovative design makes the unit easy to carry and position within technical room occupying the minimum footprint. The Modular conception allows to position one unit upon the other reaching the highest kW/m² ratio on the market.

Plug & play installation The units is conceived in order to be connected quickly to the plant. Victaulic connection are available as option.

Superior control logic The unit controller provides an easy to use control environmental. The control logic is designed to provide maximum efficiency, to continue operation in unusual operating conditions and to provide a history of unit operation. One of the greatest benefits is the easy interface with LonWorks, Bacnet, Ethernet TCP/IP or Modbus communications. Master/Slave control is available as standard.

Code requirements – Safety and observant of laws/directives Units are designed and manufactured in accordance with applicable selections of the following:

| | |
|---------------------------------|----------------------------|
| Construction of pressure vessel | 97/23/EC (PED) |
| Machinery Directive | 2006/42/EC |
| Low Voltage | 2006/95/EC |
| Electromagnetic Compatibility | 2004/108/EC |
| Electrical & Safety codes | EN 60204-1 / EN 60335-2-40 |
| Manufacturing Quality Stds | UNI – EN ISO 9001:2004 |

Certifications Units are CE marked, complying with European directives in force, concerning manufacturing and safety. On request units can be produced complying with laws in force in non European countries (ASME, GOST, etc.), and with other applications, such as naval (RINA, etc.).

Versions This range is available in one version:

STANDARD EFFICIENCY

24 sizes to cover a range 87 up to 676 kW with an EER up to 3.92.

The EER (Energy Efficiency Ratio) is the ratio of the Cooling Capacity to the Power Input of the unit. The Power Input includes: the power input for operation of the compressor, the power input of all control and safety devices.

Sound configurations STANDARD SOUND

(Compressor sound attenuation jacket or compressor sound enclosure available as option)

Cabinet and structure The cabinet is made of galvanized steel sheet and painted to provide a high resistance to corrosion. Colour Ivory White (Munsell code 5Y7.5/1) (\pm RAL7044). The base frame has an eye-hook to lift the unit with ropes for an easy installation. The weight is uniformly distributed along the profiles of the base and this facilitates the arrangement of the unit.

Refrigerant Units have been optimized to operate with R-410A, refrigerant with zero ODP (Ozone Depletion Potential) and GWP (Global Warming Potential) 1890. R-410A has been the logical choice for our multiple scroll chiller because today it is one of the most promising refrigerants in terms of efficiency, stability and environmental impact. R-410A offers a small swept volume, a good heat exchange capacity and leads to reduced component sizes of items such as heat exchangers and tubing.

Compressor The compressor is hermetic orbiting scroll compressor complete with motor over-temperature and over-current devices. An oil heater, which starts automatically, keeps the oil from being diluted by the refrigerant when the compressor stops. The compressors are connected in Tandem on a single refrigerating circuit and are fitted on rubber antivibration mounts and complete with oil charge.

Evaporator (Plate Heat Exchanger) The unit is equipped with a direct expansion plate to plate type evaporator. This heat exchanger is made of stainless steel brazed plates and is covered with a 20mm closed cell insulation material. The evaporator is manufactured in accordance to PED approval. Flow switch and victaulic kit are provided mounted as option.

Electronic expansion valve The unit is equipped with the most advanced electronic expansion valves to achieve precise control of refrigerant mass flow. As today's system requires improved energy efficiency, tighter temperature control, wider range of operating conditions and incorporate features like remote monitoring and diagnostics, the application of electronic expansion valves becomes mandatory.

Electronic expansion valves possess unique features: short opening and closing time, high resolution, positive shut-off function to eliminate use of additional solenoid valve, continuous modulation of mass flow without stress in the refrigerant circuit and corrosion resistance stainless steel body.

Electronic expansion valves are typically working with lower ΔP between high and low pressure side, than a thermostatic expansion valve. The electronic expansion valve allows the system to work with low condenser pressure without any refrigerant flow problems and with a perfect chilled water leaving temperature control.

Refrigerant circuit Each unit has 1 or 2 refrigerant circuit, according to the capacity, that includes:

- Compressors
- Refrigerant
- Evaporator
- Electronic expansion valve
- Liquid line shut off valve
- Filter drier
- Sight glass with moisture indicator
- High pressure switch
- High pressure transducers
- Low pressure transducers
- Suction temperature sensor

Electrical control panel Power and control are located in the main panel. The electrical panel is IP54 and (when opening the doors) internally protected with plexiglass panel against possible accidental contact with electrical components (IP20). The main panel is fitted with a main switch interlocked door.

Power Section

The power section includes compressors protection devices, compressors starters and control circuit power supply.

Unit controller

Unit controller is installed as standard; it can be used to modify unit set-points and check control parameters. A built-in display shows chiller operating status plus temperatures and pressures of water, refrigerant, programmable values, set-points. A sophisticated software with predictive logic, selects the most energy efficient combination of compressors and EEXV to keep stable operating conditions to maximise chiller energy efficiency and reliability.

The unit controller is able to protect critical components based on external signs from its system (such as motor temperatures, refrigerant gas and oil pressures, correct phase sequence, pressure switches and evaporator). The input coming from the high pressure switch cuts all digital output from the controller in less than 50ms, this is an additional security for the equipment.

Fast program cycle (200ms) for a precise monitoring of the system. Floating point calculations supported for increased accuracy in Pressure / Temperature conversions.

Control section - main features

Control Section has the following feature.

- Management of the refrigerant circuit capacity
- Chiller enabled to work in partial failure condition (only for 2 circuits unit)
- Full routine operation at condition of:
 - high thermal load
 - high evaporator entering water temperature (start-up)
- Display of evaporator entering/leaving water temperature.
- Display of condensing-evaporating temperature and pressure, suction superheat for each circuit.
- Leaving water evaporator temperature regulation .
- Compressor and pumps hours counter.
- Display of Status Safety Devices.
- Number of starts and compressor working hours.
- Optimized management of compressor load.
- Re-start in case of power failure (automatic / manual).
- Soft Load (optimized management of the compressor load during the start-up).
- Start at high evaporator water temperature.
- Return Reset (Set Point Reset based on return water temperature).
- Set point Reset (optional).
- Application and system upgrade with commercial SD cards.
- Ethernet port for remote or local servicing using standard web browsers.

Safety device / logic for each refrigerant circuit

The following devices / logics are available.

- High pressure (pressure switch).
- High pressure (transducer).
- Low pressure (transducer).
- High motor winding temperature.
- No pressure change at start

System security

The following securities are available.

- Phase monitor.
- Freeze protection.

Regulation type

Proportional + integral + derivative regulation on the evaporator leaving water output probe.

Unit controller

Unit controller built-in terminal has the following features.

- 164x44 dots liquid crystal display with white back lighting. Supports Unicode fonts for multi-lingual.
- Key-pad consisting of 3 keys.
- Push'n'Roll control for an increased usability.
- Memory to protect the data.
- General faults alarm relays.
- Password access to modify the setting.
- Application security to prevent application tampering or hardware usability with third party applications.
- Service report displaying all running hours and general conditions.
- Alarm history memory to allow an easy fault analysis.

Supervising systems (on request)**Unit controller remote communication**

Unit controller is able to communicate to BMS (Building Management System) based on the most common protocols as:

- ModbusRTU
- LonWorks, now also based on the international 8040 Standard Chiller Profile and LonMark Technology.
- BacNet BTP certified over IP and MS/TP (class 4) (Native).
- Ethernet TCP/IP.

Additional information related to F-GAS Regulation (EU) No 517/2014 OF THE European Parliament and of the Council of 16 April 2014 on fluorinated greenhouse gases and repealing Regulation (EC) No 842/2006

| Unit model | Refrigerant type | Refrigerant GWP | No. of circuits | Refrigerant charge circuit 1 (kg) |
|-------------|------------------|-----------------|-----------------|-----------------------------------|
| EWLQ090G-SS | R410A | 2087,5 | 1 | 0,0 |
| EWLQ100G-SS | R410A | 2087,5 | 1 | 0,0 |
| EWLQ120G-SS | R410A | 2087,5 | 1 | 0,0 |
| EWLQ130G-SS | R410A | 2087,5 | 1 | 0,0 |
| EWLQ150G-SS | R410A | 2087,5 | 1 | 0,0 |
| EWLQ170G-SS | R410A | 2087,5 | 1 | 0,0 |
| EWLQ190G-SS | R410A | 2087,5 | 1 | 0,0 |
| EWLQ210G-SS | R410A | 2087,5 | 1 | 0,0 |
| EWLQ240G-SS | R410A | 2087,5 | 1 | 0,0 |
| EWLQ300G-SS | R410A | 2087,5 | 1 | 0,0 |
| EWLQ360G-SS | R410A | 2087,5 | 1 | 0,0 |

Note: Its functioning relies on fluorinated greenhouse gases

Options (on request)

MECHANICAL

Heat Pump version reversing on water side

Evaporator victaulic kit- Hydraulic joint with gasket for an easy and quick water connection.

Water filter(*) - The water filter removes impurities from water by means of a fine physical barrier. The installation of the filter is mandatory.

Evaporator flow switch The installation of the flow switch is mandatory on evaporator.

Brine version - Allows the unit to operate down to -10°C leaving liquid temperature (antifreeze required). Recommended below +4°C

Suction and discharge line shut-off valve - Installed on the suction and discharge ports of the compressor’s tandem to facilitate maintenance operation.

High pressure side manometers Low pressure side manometers

Sound Proof System (Compressor Enclosure)

One centrifugal pump (low lift) - Hydronic kit consists of: single direct driven centrifugal pump, water filling system with pressure gauge, safety valve, drain valve. The motor pump is protected by a circuit breaker installed in control panel. The kit is assembled and wired to the control panel. The pipe and pump are protected from freezing with an additional electrical heater.

One centrifugal pump (high lift) Hydronic kit consists of: single direct driven centrifugal pump, water filling system with pressure gauge, safety valve, drain valve. The motor pump is protected by a circuit breaker installed in control panel. The kit is assembled and wired to the control panel. The pipe and pump are protected from freezing with an additional electrical heater.

Double pressure relief valve with diverter The high pressure safety valve in standard configuration and with OP 91 “Double pressure relief valve with diverter” selected, is installed only on the following models with the wording “YES”;

| Model | High Pressure relief valve |
|-------------|----------------------------|
| EWLQ090G-SS | NO* |
| EWLQ100G-SS | NO* |
| EWLQ120G-SS | NO* |
| EWLQ130G-SS | NO* |
| EWLQ150G-SS | YES** |
| EWLQ170G-SS | YES** |
| EWLQ190G-SS | YES** |
| EWLQ210G-SS | YES** |
| EWLQ240G-SS | YES** |
| EWLQ300G-SS | YES** |
| EWLQ360G-SS | YES** |
| EWLQ180L-SS | NO* |
| EWLQ205L-SS | NO* |
| EWLQ230L-SS | NO* |
| EWLQ260L-SS | NO* |
| EWLQ290L-SS | YES** |
| EWLQ330L-SS | YES** |
| EWLQ380L-SS | YES** |
| EWLQ430L-SS | YES** |
| EWLQ480L-SS | YES** |
| EWLQ540L-SS | YES** |
| EWLQ600L-SS | YES** |
| EWLQ660L-SS | YES** |
| EWLQ720L-SS | YES** |

*For EN 378, on models without high pressure relief valves, only a pressure cut-out is required

** For models with pressure relief valves, the sizing is based on the event of excessive pressure caused by compressors.

ELECTRICAL / CONTROL

Compressor thermal overload relays - Safety electronic devices that, added to the standard protection devices, protect compressor motors against overload and current unbalance.

Phase monitor - Device that monitors input voltage and stops the chiller in case of phase loss or wrong phase sequence.

Under / Over voltage control - Electronic device that monitors and displays input voltage, and stops the chiller in case of phase loss, wrong phase sequence, or voltage exceeding minimum and maximum allowed values.

Energy meter - Device installed inside the control box that displays all chiller electrical power parameters at line input such as line voltage and phase current, input active and reactive power, active and reactive energy. An integrated RS485 module allows a Modbus communication to an external BMS.

Capacitors for power factor correction - Devices that increase the power factor of the unit. The capacitors are "dry" self-regenerating type with over pressure disconnecting safety device insulated with a no toxic dielectric mix without PCB or PCT.

Setpoint reset, Demand limit and Alarm from external device - Setpoint Reset: The leaving water temperature set-point can be overwritten with an external 4-20mA, through the ambient temperature, or through the evaporator water temperature ΔT . Demand Limit: Chiller capacity can be limited through an external 4-20mA signal or via network. Alarm from external device: The unit controller is able to receive an external alarm signal. The user can decide whether this alarm signal will stop the unit or not.

Compressors circuit breakers Safety devices that include in a single device all safety functions otherwise provided by standard fuses and optional thermal relays, such as protection against overcurrent, overload, current unbalance.


INSTALLATION

Rubber anti vibration mounts - Supplied separately, these are positioned under the base of the unit during installation. Ideal to reduce the vibrations when the unit is floor mounted.

Container Kit: wooden pallet structure positioned below the unit specially designed to ease the chiller (un)load in the container with a forklift.

Witness test

Acoustic test

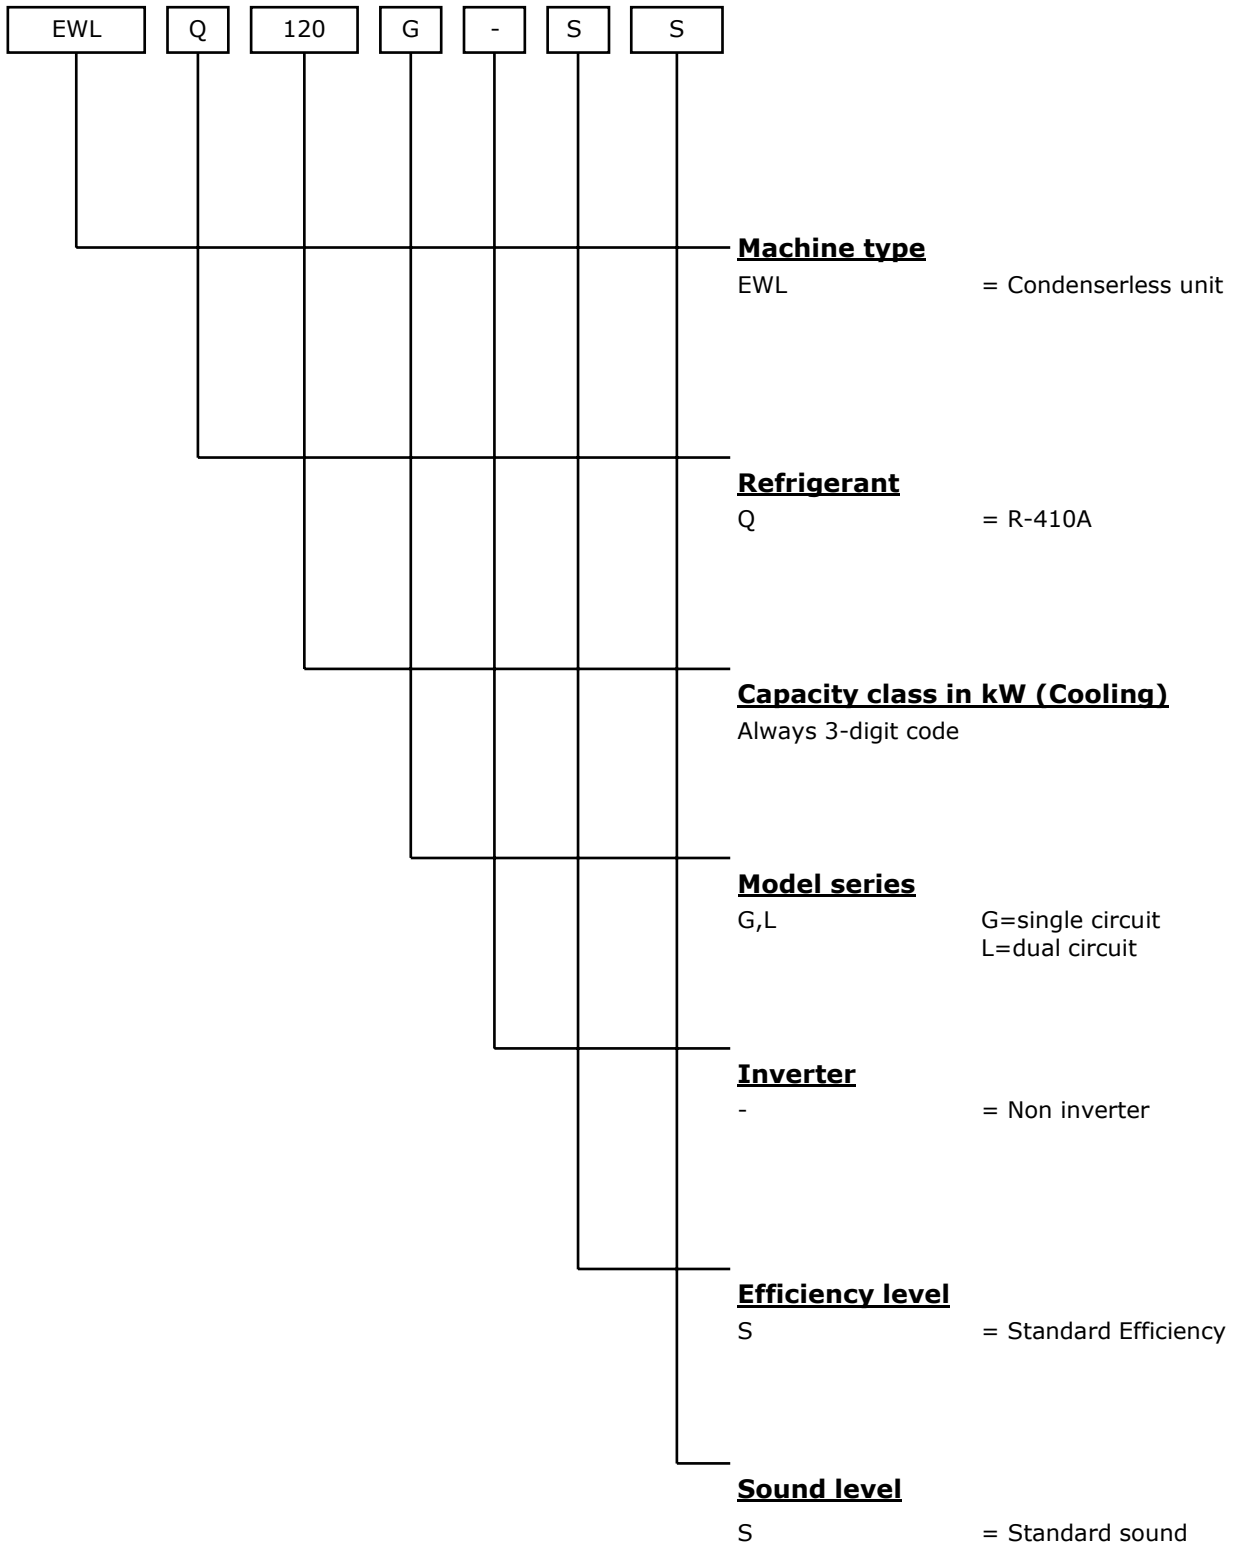

EWLQ G-SS

| MODEL | | 090 | 100 | 120 | 130 | 150 | 170 | 190 | 210 |
|-------------------------------------|-------|------------|------------|------------|------------|------------|------------|------------|------------|
| Capacity - Cooling (1) | kW | 86.5 | 98.4 | 110 | 125 | 139 | 160 | 181 | 206 |
| Capacity control - Type | --- | Step | Step | Step | Step | Step | Step | Step | Step |
| Capacity control - Minimum capacity | % | 50.0 | 43.0 | 50.0 | 44.0 | 50.0 | 45.0 | 50.0 | 43.0 |
| Unit power input - Cooling (1) | kW | 22.4 | 25.8 | 29.2 | 33.0 | 36.8 | 42.0 | 47.0 | 54.2 |
| EER (1) | --- | 3.86 | 3.81 | 3.78 | 3.79 | 3.79 | 3.80 | 3.86 | 3.80 |
| CASING | | | | | | | | | |
| Colour | --- | IW | IW | IW | IW | IW | IW | IW | IW |
| Material (2) | --- | GPSS | GPSS | GPSS | GPSS | GPSS | GPSS | GPSS | GPSS |
| DIMENSIONS | | | | | | | | | |
| Height | mm | 1066 | 1066 | 1066 | 1066 | 1066 | 1066 | 1066 | 1066 |
| Width | mm | 928 | 928 | 928 | 928 | 928 | 928 | 928 | 928 |
| Length | mm | 2743 | 2743 | 2743 | 2743 | 2743 | 2743 | 2743 | 2743 |
| WEIGHT | | | | | | | | | |
| Unit Weight | kg | 525 | 615 | 729 | 760 | 791 | 826 | 863 | 901 |
| Operating Weight | kg | 494 | 578 | 686 | 714 | 742 | 773 | 807 | 838 |
| HEAT EXCHANGER - EVAPORATOR | | | | | | | | | |
| Type (3) | --- | PHE | PHE | PHE | PHE | PHE | PHE | PHE | PHE |
| Water Volume | l | 6 | 8 | 8 | 10 | 12 | 13 | 15 | 17 |
| Nominal water flow rate | l/s | 4.2 | 4.7 | 5.3 | 6.0 | 6.7 | 7.7 | 8.7 | 9.8 |
| Nominal Water pressure drop | kPa | 44 | 44 | 35 | 29 | 29 | 31 | 33 | 30 |
| Insulation material (4) | | CC | CC | CC | CC | CC | CC | CC | CC |
| COMPRESSOR | | | | | | | | | |
| Type | --- | Scroll | Scroll | Scroll | Scroll | Scroll | Scroll | Scroll | Scroll |
| Oil charge | l | 7 | 8 | 9 | 11 | 14 | 13 | 13 | 13 |
| Quantity | No. | 2 | 2 | 2 | 2 | 2 | 2 | 2 | 2 |
| SOUND LEVEL | | | | | | | | | |
| Sound Power - Cooling | dB(A) | 80 | 83 | 85 | 87 | 88 | 88 | 88 | 90 |
| Sound Pressure - Cooling (5) | dB(A) | 64 | 67 | 69 | 70 | 72 | 72 | 72 | 74 |
| REFRIGERANT CIRCUIT | | | | | | | | | |
| Refrigerant type | --- | R410A | R410A | R410A | R410A | R410A | R410A | R410A | R410A |
| Refrigerant charge | kg | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 |
| N. of circuits | No. | 1 | 1 | 1 | 1 | 1 | 1 | 1 | 1 |
| PIPING CONNECTIONS | | | | | | | | | |
| Evaporator water inlet/outlet | | 1" 1/2 | 1" 1/2 | 2" 1/2 | 2" 1/2 | 2" 1/2 | 2" 1/2 | 2" 1/2 | 2" 1/2 |
| Outlet gas discharge connections | | 1" 5/8 | 1" 5/8 | 1" 5/8 | 1" 5/8 | 1" 5/8 | 1" 5/8 | 1" 5/8 | 1" 5/8 |

Fluid: Water

(1) Cooling capacity, unit power input and EER are based on the following conditions: evaporator 12.0/7.0°C; condensing temperature 45.0, unit at full load operation;

(2) GPSS: Galvanized and Painted Steel Sheet; (3) PHE: Plate Heat Exchanger --- S&T: Single Pass Shell & Tube

(4) CC: Closed Cell; (5) The values are according to ISO 3744 and are referred to: evaporator 12.0/7.0°C, condensing temperature 45.0, full load operation.

EWLQ G-SS

| MODEL | | 240 | 300 | 360 | | | | | |
|-------------------------------------|-------|------------|------------|------------|--|--|--|--|--|
| Capacity - Cooling (1) | kW | 231 | 290 | 346 | | | | | |
| Capacity control - Type | --- | Step | Step | Step | | | | | |
| Capacity control - Minimum capacity | % | 50.0 | 40.0 | 50.0 | | | | | |
| Unit power input - Cooling (1) | kW | 59.9 | 75.6 | 91.8 | | | | | |
| EER (1) | --- | 3.85 | 3.84 | 3.77 | | | | | |
| CASING | | | | | | | | | |
| Colour | --- | IW | IW | IW | | | | | |
| Material (2) | --- | GPSS | GPSS | GPSS | | | | | |
| DIMENSIONS | | | | | | | | | |
| Height | mm | 1066 | 1186 | 1186 | | | | | |
| Width | mm | 928 | 928 | 928 | | | | | |
| Length | mm | 2743 | 2743 | 2743 | | | | | |
| WEIGHT | | | | | | | | | |
| Unit Weight | kg | 916 | 1044 | 1134 | | | | | |
| Operating Weight | kg | 852 | 967 | 1046 | | | | | |
| HEAT EXCHANGER - EVAPORATOR | | | | | | | | | |
| Type (3) | --- | PHE | PHE | PHE | | | | | |
| Water Volume | l | 17 | 27 | 34 | | | | | |
| Nominal water flow rate | l/s | 11.1 | 13.9 | 16.6 | | | | | |
| Nominal Water pressure drop | kPa | 38 | 41 | 41 | | | | | |
| Insulation material (4) | | CC | CC | CC | | | | | |
| COMPRESSOR | | | | | | | | | |
| Type | --- | Scroll | Scroll | Scroll | | | | | |
| Oil charge | l | 13 | 13 | 13 | | | | | |
| Quantity | No. | 2 | 2 | 2 | | | | | |
| SOUND LEVEL | | | | | | | | | |
| Sound Power - Cooling | dB(A) | 92 | 93 | 93 | | | | | |
| Sound Pressure - Cooling (5) | dB(A) | 76 | 76 | 77 | | | | | |
| REFRIGERANT CIRCUIT | | | | | | | | | |
| Refrigerant type | --- | R410A | R410A | R410A | | | | | |
| Refrigerant charge | kg | 0 | 0 | 0 | | | | | |
| N. of circuits | No. | 1 | 1 | 1 | | | | | |
| PIPING CONNECTIONS | | | | | | | | | |
| Evaporator water inlet/outlet | | 2" 1/2 | 3" | 3" | | | | | |
| Outlet gas discharge connections | | 1" 5/8 | 2" 1/8 | 2" 1/8 | | | | | |

Fluid: Water

(1) Cooling capacity, unit power input and EER are based on the following conditions: evaporator 12.0/7.0°C; condensing temperature 45.0, unit at full load operation;

(2) GPSS: Galvanized and Painted Steel Sheet; (3) PHE: Plate Heat Exchanger --- S&T: Single Pass Shell & Tube

(4) CC: Closed Cell; (5) The values are according to ISO 3744 and are referred to: evaporator 12.0/7.0°C, condensing temperature 45.0, full load operation.

EWLQ L-SS

| MODEL | | 180 | 205 | 230 | 260 | 290 | 330 | 380 | 430 |
|-------------------------------------|-------|---------------|---------------|---------------|---------------|---------------|---------------|---------------|---------------|
| Capacity - Cooling (1) | kW | 173 | 197 | 224 | 249 | 279 | 317 | 361 | 409 |
| Capacity control - Type | --- | Step | Step | Step | Step | Step | Step | Step | Step |
| Capacity control - Minimum capacity | % | 25.0 | 21.0 | 25.0 | 22.0 | 25.0 | 23.0 | 25.0 | 21.0 |
| Unit power input - Cooling (1) | kW | 44.3 | 51.1 | 57.9 | 65.6 | 73.2 | 83.8 | 93.5 | 108 |
| EER (1) | --- | 3.91 | 3.86 | 3.87 | 3.79 | 3.81 | 3.78 | 3.86 | 3.79 |
| CASING | | | | | | | | | |
| Colour | --- | IW | IW | IW | IW | IW | IW | IW | IW |
| Material (2) | --- | GPSS | GPSS | GPSS | GPSS | GPSS | GPSS | GPSS | GPSS |
| DIMENSIONS | | | | | | | | | |
| Height | mm | 1970 | 1970 | 1970 | 1970 | 1970 | 1970 | 1970 | 1970 |
| Width | mm | 928 | 928 | 928 | 928 | 928 | 928 | 928 | 928 |
| Length | mm | 2801 | 2801 | 2801 | 2801 | 2801 | 2801 | 2801 | 2801 |
| WEIGHT | | | | | | | | | |
| Unit Weight | kg | 894 | 1081 | 1292 | 1345 | 1436 | 1486 | 1547 | 1638 |
| Operating Weight | kg | 832 | 1007 | 1202 | 1252 | 1333 | 1380 | 1432 | 1511 |
| HEAT EXCHANGER - EVAPORATOR | | | | | | | | | |
| Type (3) | --- | PHE | PHE | PHE | PHE | PHE | PHE | PHE | PHE |
| Water Volume | l | 19 | 22 | 29 | 29 | 35 | 35 | 41 | 49 |
| Nominal water flow rate | l/s | 8.3 | 9.5 | 10.7 | 11.9 | 13.4 | 15.2 | 17.3 | 19.6 |
| Nominal Water pressure drop | kPa | 25 | 25 | 20 | 25 | 22 | 29 | 29 | 29 |
| Insulation material (4) | | CC | CC | CC | CC | CC | CC | CC | CC |
| COMPRESSOR | | | | | | | | | |
| Type | --- | Scroll | Scroll | Scroll | Scroll | Scroll | Scroll | Scroll | Scroll |
| Oil charge | l | 14 | 16 | 19 | 23 | 27 | 26 | 25 | 25 |
| Quantity | No. | 4 | 4 | 4 | 4 | 4 | 4 | 4 | 4 |
| SOUND LEVEL | | | | | | | | | |
| Sound Power - Cooling | dB(A) | 83 | 86 | 88 | 90 | 91 | 91 | 91 | 93 |
| Sound Pressure - Cooling (5) | dB(A) | 65 | 68 | 70 | 72 | 74 | 74 | 73 | 76 |
| REFRIGERANT CIRCUIT | | | | | | | | | |
| Refrigerant type | --- | R410A | R410A | R410A | R410A | R410A | R410A | R410A | R410A |
| Refrigerant charge | kg | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 |
| N. of circuits | No. | 2 | 2 | 2 | 2 | 2 | 2 | 2 | 2 |
| PIPING CONNECTIONS | | | | | | | | | |
| Evaporator water inlet/outlet | | 3" | 3" | 3" | 3" | 3" | 3" | 3" | 3" |
| Outlet gas discharge connections | | 1" 5/8-1" 5/8 | 1" 5/8-1" 5/8 | 1" 5/8-1" 5/8 | 1" 5/8-1" 5/8 | 1" 5/8-1" 5/8 | 1" 5/8-1" 5/8 | 1" 5/8-1" 5/8 | 1" 5/8-1" 5/8 |

Fluid: Water

(1) Cooling capacity, unit power input and EER are based on the following conditions: evaporator 12.0/7.0°C; condensing temperature 45.0, unit at full load operation;

(2) GPSS: Galvanized and Painted Steel Sheet; (3) PHE: Plate Heat Exchanger --- S&T: Single Pass Shell & Tube

(4) CC: Closed Cell; (5) The values are according to ISO 3744 and are referred to: evaporator 12.0/7.0°C, condensing temperature 45.0, full load operation.

EWLQ L-SS

| MODEL | | 480 | 540 | 600 | 660 | 720 | | | |
|-------------------------------------|-------|------------------|------------------|------------------|------------------|------------------|--|--|--|
| Capacity - Cooling (1) | kW | 459 | 511 | 571 | 624 | 676 | | | |
| Capacity control - Type | --- | Step | Step | Step | Step | Step | | | |
| Capacity control - Minimum capacity | % | 25.0 | 22.0 | 20.0 | 18.0 | 25.0 | | | |
| Unit power input - Cooling (1) | kW | 119 | 135 | 152 | 168 | 184 | | | |
| EER (1) | --- | 3.84 | 3.78 | 3.76 | 3.71 | 3.67 | | | |
| CASING | | | | | | | | | |
| Colour | --- | IW | IW | IW | IW | IW | | | |
| Material (2) | --- | GPSS | GPSS | GPSS | GPSS | GPSS | | | |
| DIMENSIONS | | | | | | | | | |
| Height | mm | 1970 | 2090 | 2210 | 2210 | 2210 | | | |
| Width | mm | 928 | 928 | 928 | 928 | 928 | | | |
| Length | mm | 2801 | 2801 | 2801 | 2801 | 2801 | | | |
| WEIGHT | | | | | | | | | |
| Unit Weight | kg | 1690 | 1741 | 1844 | 1990 | 2120 | | | |
| Operating Weight | kg | 1560 | 1609 | 1694 | 1833 | 1957 | | | |
| HEAT EXCHANGER - EVAPORATOR | | | | | | | | | |
| Type (3) | --- | PHE | PHE | PHE | PHE | PHE | | | |
| Water Volume | l | 49 | 49 | 62 | 62 | 62 | | | |
| Nominal water flow rate | l/s | 21.9 | 24.5 | 27.3 | 29.9 | 32.4 | | | |
| Nominal Water pressure drop | kPa | 36 | 45 | 44 | 52 | 62 | | | |
| Insulation material (4) | | CC | CC | CC | CC | CC | | | |
| COMPRESSOR | | | | | | | | | |
| Type | --- | Scroll | Scroll | Scroll | Scroll | Scroll | | | |
| Oil charge | l | 25 | 25 | 25 | 25 | 25 | | | |
| Quantity | No. | 4 | 4 | 4 | 4 | 4 | | | |
| SOUND LEVEL | | | | | | | | | |
| Sound Power - Cooling | dB(A) | 95 | 95 | 95 | 96 | 96 | | | |
| Sound Pressure - Cooling (5) | dB(A) | 77 | 77 | 78 | 78 | 78 | | | |
| REFRIGERANT CIRCUIT | | | | | | | | | |
| Refrigerant type | --- | R410A | R410A | R410A | R410A | R410A | | | |
| Refrigerant charge | kg | 0 | 0 | 0 | 0 | 0 | | | |
| N. of circuits | No. | 2 | 2 | 2 | 2 | 2 | | | |
| PIPING CONNECTIONS | | | | | | | | | |
| Evaporator water inlet/outlet | | 3" | 3" | 3" | 3" | 3" | | | |
| Outlet gas discharge connections | | 1" 5/8-1" 5/8 | 1" 5/8-2" 1/8 | 2" 1/8-2" 1/8 | 2" 1/8-2" 1/8 | 2" 1/8-2" 1/8 | | | |

Fluid: Water

(1) Cooling capacity, unit power input and EER are based on the following conditions: evaporator 12.0/7.0°C; condensing temperature 45.0, unit at full load operation;

(2) GPSS: Galvanized and Painted Steel Sheet; (3) PHE: Plate Heat Exchanger --- S&T: Single Pass Shell & Tube

(4) CC: Closed Cell; (5) The values are according to ISO 3744 and are referred to: evaporator 12.0/7.0°C, condensing temperature 45.0, full load operation.

EWLQ G-SS

| MODEL | | 090 | 100 | 120 | 130 | 150 | 170 | 190 | 210 |
|----------------------------------|-----|------|------|------|------|------|------|------|------|
| Power supply | | | | | | | | | |
| Phases | --- | 3 | 3 | 3 | 3 | 3 | 3 | 3 | 3 |
| Frequency | Hz | 50 | 50 | 50 | 50 | 50 | 50 | 50 | 50 |
| Voltage | V | 400 | 400 | 400 | 400 | 400 | 400 | 400 | 400 |
| Voltage tollerance Minimum | % | -10% | -10% | -10% | -10% | -10% | -10% | -10% | -10% |
| Voltage tollerance Maximum | % | +10% | +10% | +10% | +10% | +10% | +10% | +10% | +10% |
| Unit | | | | | | | | | |
| Maximum starting current | A | 204 | 255 | 261 | 308 | 316 | 354 | 368 | 466 |
| Nominal running current cooling | A | 39 | 42 | 45 | 51 | 57 | 64 | 70 | 81 |
| Maximum running current | A | 59 | 66 | 72 | 80 | 88 | 102 | 116 | 131 |
| Maximum current for wires sizing | A | 65 | 72 | 79 | 88 | 96 | 112 | 128 | 144 |
| Compressors | | | | | | | | | |
| Phases | No. | 3 | 3 | 3 | 3 | 3 | 3 | 3 | 3 |
| Voltage | V | 400 | 400 | 400 | 400 | 400 | 400 | 400 | 400 |
| Voltage tollerance Minimum | % | -10% | -10% | -10% | -10% | -10% | -10% | -10% | -10% |
| Voltage tollerance Maximum | % | +10% | +10% | +10% | +10% | +10% | +10% | +10% | +10% |
| Maximum running current | A | 59 | 66 | 72 | 80 | 88 | 102 | 116 | 131 |
| Starting method | --- | DOL | DOL | DOL | DOL | DOL | DOL | DOL | DOL |

EWLQ G-SS

| MODEL | | 240 | 300 | 360 | | | | | |
|----------------------------------|-----|------|--------|------|--|--|--|--|--|
| Power supply | | | | | | | | | |
| Phases | --- | 3 | 3 | 3 | | | | | |
| Frequency | Hz | 50 | 50 | 50 | | | | | |
| Voltage | V | 400 | 400 | 400 | | | | | |
| Voltage tollerance Minimum | % | -10% | -10% | -10% | | | | | |
| Voltage tollerance Maximum | % | +10% | +10% | +10% | | | | | |
| Unit | | | | | | | | | |
| Maximum starting current | A | 481 | 640 | 677 | | | | | |
| Nominal running current cooling | A | 88 | 111 | 135 | | | | | |
| Maximum running current | A | 145 | 183 | 221 | | | | | |
| Maximum current for wires sizing | A | 160 | 201 | 243 | | | | | |
| Compressors | | | | | | | | | |
| Phases | No. | 3 | 3 | 3 | | | | | |
| Voltage | V | 400 | 400 | 400 | | | | | |
| Voltage tollerance Minimum | % | -10% | -10% | -10% | | | | | |
| Voltage tollerance Maximum | % | +10% | +10% | +10% | | | | | |
| Maximum running current | A | 145 | 183 | 221 | | | | | |
| Starting method | --- | DOL | DOL+PW | PW | | | | | |

Fluid: Water

Allowed voltage tolerance ± 10%. Voltage unbalance between phases must be within ± 3%.

Maximum starting current: starting current of biggest compressor + current of the compressor at 75% maximum load

Nominal current in cooling mode is referred to the following conditions: evaporator 12/7°C; condenser 30/35°C; compressors current

Maximum running current is based on max compressor absorbed current in its envelope

Maximum unit current for wires sizing is based on minimum allowed voltage

Maximum current for wires sizing: (compressors full load ampere) × 1,1.

EWLQ L-SS

| MODEL | | 180 | 205 | 230 | 260 | 290 | 330 | 380 | 430 |
|----------------------------------|-----|------|------|------|------|------|------|------|------|
| Power supply | | | | | | | | | |
| Phases | --- | 3 | 3 | 3 | 3 | 3 | 3 | 3 | 3 |
| Frequency | Hz | 50 | 50 | 50 | 50 | 50 | 50 | 50 | 50 |
| Voltage | V | 400 | 400 | 400 | 400 | 400 | 400 | 400 | 400 |
| Voltage tollerance Minimum | % | -10% | -10% | -10% | -10% | -10% | -10% | -10% | -10% |
| Voltage tollerance Maximum | % | +10% | +10% | +10% | +10% | +10% | +10% | +10% | +10% |
| Unit | | | | | | | | | |
| Maximum starting current | A | 263 | 320 | 333 | 388 | 403 | 456 | 484 | 597 |
| Nominal running current cooling | A | 78 | 84 | 90 | 102 | 114 | 128 | 141 | 161 |
| Maximum running current | A | 118 | 131 | 144 | 160 | 175 | 205 | 232 | 262 |
| Maximum current for wires sizing | A | 130 | 144 | 159 | 176 | 193 | 225 | 255 | 288 |
| Compressors | | | | | | | | | |
| Phases | No. | 3 | 3 | 3 | 3 | 3 | 3 | 3 | 3 |
| Voltage | V | 400 | 400 | 400 | 400 | 400 | 400 | 400 | 400 |
| Voltage tollerance Minimum | % | -10% | -10% | -10% | -10% | -10% | -10% | -10% | -10% |
| Voltage tollerance Maximum | % | +10% | +10% | +10% | +10% | +10% | +10% | +10% | +10% |
| Maximum running current | A | 59 | 66 | 72 | 80 | 88 | 102 | 116 | 131 |
| | | 59 | 66 | 72 | 80 | 88 | 102 | 116 | 131 |
| Starting method | --- | DOL | DOL | DOL | DOL | DOL | DOL | DOL | DOL |

EWLQ L-SS

| MODEL | | 480 | 540 | 600 | 660 | 720 | | | |
|----------------------------------|-----|------|------|--------|--------|------|--|--|--|
| Power supply | | | | | | | | | |
| Phases | --- | 3 | 3 | 3 | 3 | 3 | | | |
| Frequency | Hz | 50 | 50 | 50 | 50 | 50 | | | |
| Voltage | V | 400 | 400 | 400 | 400 | 400 | | | |
| Voltage tollerance Minimum | % | -10% | -10% | -10% | -10% | -10% | | | |
| Voltage tollerance Maximum | % | +10% | +10% | +10% | +10% | +10% | | | |
| Unit | | | | | | | | | |
| Maximum starting current | A | 626 | 785 | 822 | 860 | 898 | | | |
| Nominal running current cooling | A | 176 | 199 | 223 | 246 | 269 | | | |
| Maximum running current | A | 290 | 328 | 366 | 403 | 441 | | | |
| Maximum current for wires sizing | A | 319 | 361 | 402 | 444 | 485 | | | |
| Compressors | | | | | | | | | |
| Phases | No. | 3 | 3 | 3 | 3 | 3 | | | |
| Voltage | V | 400 | 400 | 400 | 400 | 400 | | | |
| Voltage tollerance Minimum | % | -10% | -10% | -10% | -10% | -10% | | | |
| Voltage tollerance Maximum | % | +10% | +10% | +10% | +10% | +10% | | | |
| Maximum running current | A | 145 | 145 | 183 | 183 | 221 | | | |
| | | 145 | 183 | 183 | 221 | 221 | | | |
| Starting method | --- | DOL | DOL | DOL+PW | DOL+PW | PW | | | |

Fluid: Water

Allowed voltage tolerance $\pm 10\%$. Voltage unbalance between phases must be within $\pm 3\%$.

Maximum starting current: starting current of biggest compressor + current of the compressor at 75% maximum load

Nominal current in cooling mode is referred to the following conditions: evaporator 12/7°C; condenser 30/35°C; compressors current

Maximum running current is based on max compressor absorbed current in its envelope

Maximum unit current for wires sizing is based on minimum allowed voltage

Maximum current for wires sizing: (compressors full load ampere) $\times 1,1$.

EWLQ G-SS

| MODEL | Sound pressure level at 1 m from the unit (rif. 2 x 10 ⁻⁵ Pa) | | | | | | | | | Power |
|------------|--|--------|--------|--------|---------|---------|---------|---------|-------------|-------------|
| | 63 Hz | 125 Hz | 250 Hz | 500 Hz | 1000 Hz | 2000 Hz | 4000 Hz | 8000 Hz | dB(A) | dB(A) |
| 090 | 59.0 | 61.0 | 50.2 | 59.9 | 58.6 | 56.5 | 54.3 | 52.3 | 64.0 | 80.0 |
| 100 | 62.4 | 64.4 | 60.3 | 60.3 | 58.6 | 63.1 | 54.5 | 49.1 | 67.0 | 83.0 |
| 120 | 65.2 | 67.0 | 63.5 | 62.1 | 60.2 | 66.1 | 56.2 | 47.3 | 69.0 | 85.0 |
| 130 | 63.0 | 64.9 | 62.9 | 61.8 | 65.0 | 66.4 | 57.9 | 53.6 | 70.0 | 87.0 |
| 150 | 60.8 | 62.7 | 63.1 | 62.2 | 67.6 | 67.3 | 59.6 | 56.4 | 72.0 | 88.0 |
| 170 | 61.1 | 63.1 | 65.4 | 64.4 | 68.0 | 67.1 | 60.0 | 55.8 | 72.0 | 88.0 |
| 190 | 60.6 | 62.6 | 66.6 | 65.6 | 67.6 | 65.6 | 59.6 | 53.6 | 72.0 | 88.0 |
| 210 | 60.7 | 62.7 | 66.0 | 63.9 | 71.4 | 68.1 | 60.2 | 54.2 | 74.0 | 90.0 |
| 240 | 61.1 | 63.1 | 65.8 | 62.1 | 73.3 | 69.7 | 60.9 | 54.9 | 76.0 | 92.0 |
| 300 | 58.8 | 60.8 | 62.8 | 57.9 | 74.6 | 69.8 | 59.0 | 53.0 | 76.0 | 93.0 |
| 360 | 57.9 | 59.9 | 61.3 | 54.9 | 75.3 | 70.1 | 58.5 | 52.5 | 77.0 | 93.0 |

EWLQ L-SS

| MODEL | Sound pressure level at 1 m from the unit (rif. 2 x 10 ⁻⁵ Pa) | | | | | | | | | Power |
|------------|--|--------|--------|--------|---------|---------|---------|---------|-------------|-------------|
| | 63 Hz | 125 Hz | 250 Hz | 500 Hz | 1000 Hz | 2000 Hz | 4000 Hz | 8000 Hz | dB(A) | dB(A) |
| 180 | 60.6 | 62.6 | 51.8 | 61.5 | 60.2 | 58.1 | 55.9 | 53.9 | 65.0 | 83.0 |
| 205 | 64.0 | 66.0 | 62.0 | 62.0 | 60.2 | 64.7 | 56.1 | 50.7 | 68.0 | 86.0 |
| 230 | 65.6 | 67.6 | 64.1 | 62.7 | 60.8 | 66.7 | 56.8 | 47.9 | 70.0 | 88.0 |
| 260 | 64.6 | 66.6 | 64.6 | 63.4 | 66.7 | 68.0 | 59.6 | 55.3 | 72.0 | 90.0 |
| 290 | 62.3 | 64.3 | 64.7 | 63.8 | 69.2 | 68.9 | 61.2 | 58.0 | 74.0 | 91.0 |
| 330 | 62.6 | 64.6 | 66.9 | 66.0 | 69.6 | 68.6 | 61.6 | 57.4 | 74.0 | 91.0 |
| 380 | 62.2 | 64.2 | 68.2 | 67.2 | 69.2 | 67.2 | 61.2 | 55.2 | 73.0 | 91.0 |
| 430 | 62.3 | 64.3 | 67.6 | 65.5 | 73.0 | 69.7 | 61.8 | 55.8 | 76.0 | 93.0 |
| 480 | 62.7 | 64.7 | 67.4 | 63.7 | 74.9 | 71.3 | 62.5 | 56.5 | 77.0 | 95.0 |
| 540 | 60.9 | 62.9 | 65.2 | 61.0 | 75.4 | 70.9 | 60.9 | 54.9 | 77.0 | 95.0 |
| 600 | 60.1 | 62.1 | 64.1 | 59.2 | 75.9 | 71.1 | 60.3 | 54.3 | 78.0 | 95.0 |
| 660 | 59.8 | 61.8 | 63.5 | 57.9 | 76.5 | 71.5 | 60.2 | 54.2 | 78.0 | 96.0 |
| 720 | 59.5 | 61.5 | 62.9 | 56.5 | 76.9 | 71.7 | 60.1 | 54.1 | 78.0 | 96.0 |

EWLQ G-SS

| SOUND PRESSURE LEVEL FOR DIFFERENT DISTANCES (dB(A)) | | | | | | | |
|--|------|------|------|------|------|------|------|
| MODEL | 1 m | 5 m | 10 m | 15 m | 20 m | 25 m | 50 m |
| 090 | 64.0 | 54.3 | 49.0 | 45.7 | 43.4 | 41.5 | 35.7 |
| 100 | 67.0 | 57.3 | 52.0 | 48.7 | 46.4 | 44.5 | 38.7 |
| 120 | 69.0 | 59.3 | 54.0 | 50.7 | 48.4 | 46.5 | 40.7 |
| 130 | 70.0 | 60.3 | 55.0 | 51.7 | 49.4 | 47.5 | 41.7 |
| 150 | 72.0 | 62.3 | 57.0 | 53.7 | 51.4 | 49.5 | 43.7 |
| 170 | 72.0 | 62.3 | 57.0 | 53.7 | 51.4 | 49.5 | 43.7 |
| 190 | 72.0 | 62.3 | 57.0 | 53.7 | 51.4 | 49.5 | 43.7 |
| 210 | 74.0 | 64.3 | 59.0 | 55.7 | 53.4 | 51.5 | 45.7 |
| 240 | 76.0 | 66.3 | 61.0 | 57.7 | 55.4 | 53.5 | 47.7 |
| 300 | 76.0 | 66.4 | 61.1 | 57.9 | 55.5 | 53.7 | 47.8 |
| 360 | 77.0 | 67.4 | 62.1 | 58.9 | 56.5 | 54.7 | 48.8 |


EWLQ L-SS

| SOUND PRESSURE LEVEL FOR DIFFERENT DISTANCES (dB(A)) | | | | | | | |
|--|------|------|------|------|------|------|------|
| MODEL | 1 m | 5 m | 10 m | 15 m | 20 m | 25 m | 50 m |
| 180 | 65.0 | 56.1 | 50.9 | 47.8 | 45.4 | 43.6 | 37.8 |
| 205 | 68.0 | 59.1 | 53.9 | 50.8 | 48.4 | 46.6 | 40.8 |
| 230 | 70.0 | 61.1 | 55.9 | 52.8 | 50.4 | 48.6 | 42.8 |
| 260 | 72.0 | 63.1 | 57.9 | 54.8 | 52.4 | 50.6 | 44.8 |
| 290 | 74.0 | 65.1 | 59.9 | 56.8 | 54.4 | 52.6 | 46.8 |
| 330 | 74.0 | 65.1 | 59.9 | 56.8 | 54.4 | 52.6 | 46.8 |
| 380 | 73.0 | 64.1 | 58.9 | 55.8 | 53.4 | 51.6 | 45.8 |
| 430 | 76.0 | 67.1 | 61.9 | 58.8 | 56.4 | 54.6 | 48.8 |
| 480 | 77.0 | 68.1 | 62.9 | 59.8 | 57.4 | 55.6 | 49.8 |
| 540 | 77.0 | 68.1 | 63.1 | 59.9 | 57.5 | 55.7 | 49.9 |
| 600 | 78.0 | 69.2 | 64.2 | 61.0 | 58.7 | 56.8 | 51.0 |
| 660 | 78.0 | 69.2 | 64.2 | 61.0 | 58.7 | 56.8 | 51.0 |
| 720 | 78.0 | 69.2 | 64.2 | 61.0 | 58.7 | 56.8 | 51.0 |

Fluid: Water

Note: The values are according to ISO 3744 and are referred to: evaporator 12/7° C, air ambient 35°C, full load operation

Operating Limits

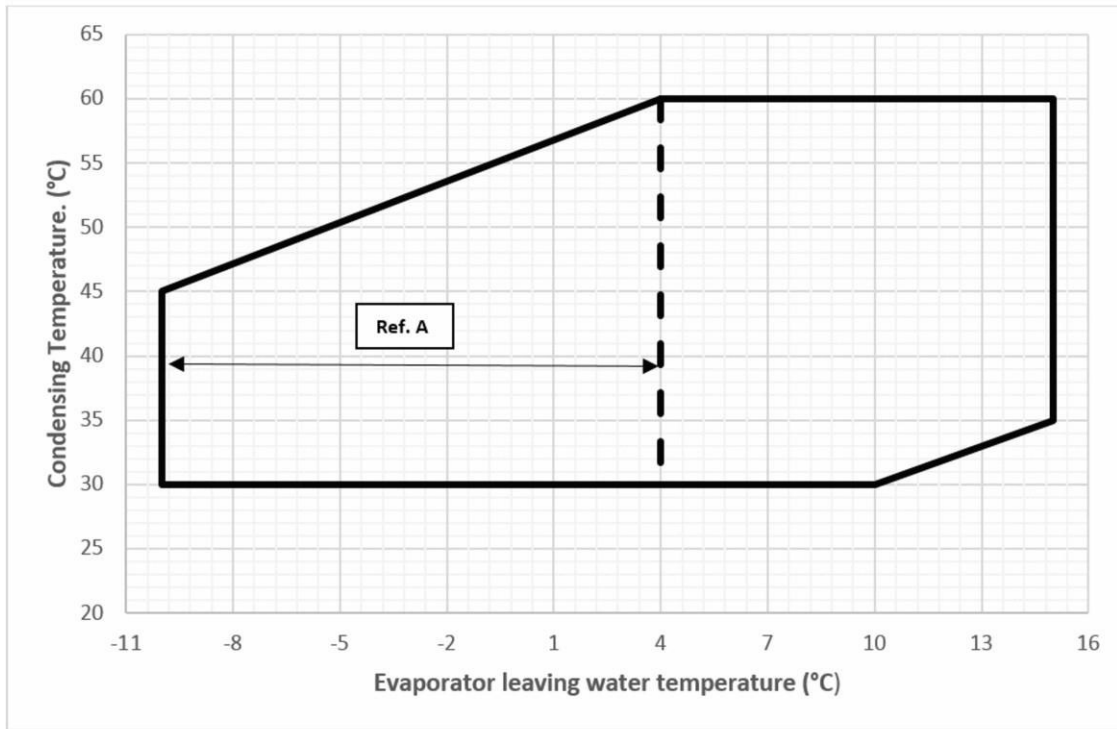

Note

The above graphic represents a guideline about the operating limits of the range. Please refer to Chiller Selection Software (CSS) for real operating limits working conditions for each size.

Ref.:

A = operation with glycol (below 4°C Evaporator LWT)

Table 1 - Water heat exchanger - Minimum and maximum water Δt

| | | |
|----------------|----|---|
| A - Δt | °C | 8 |
| B - Δt | °C | 4 |
| C - Δt | °C | 8 |
| D - Δt | °C | 4 |

Legend:

- A = Max evaporator water Δt
- B = Min evaporator water Δt
- C = Max condenser water Δt
- D = Min condenser water Δt

Table 2 - Water heat exchanger - Evaporator Fouling factors

| A | B | C | D |
|--------|-------|-------|-------|
| 0.0176 | 1.000 | 1.000 | 1.000 |
| 0.0440 | 0.978 | 0.986 | 0.992 |
| 0.0880 | 0.957 | 0.974 | 0.983 |
| 0.1320 | 0.938 | 0.962 | 0.975 |

Table 2 - Water heat exchanger - Condenser Fouling factors

| A | B | C | D |
|----------|----------|----------|----------|
| 0.0176 | 1.006 | 0.989 | 1.016 |
| 0.0440 | 1.000 | 1.000 | 1.000 |
| 0.0880 | 0.957 | 0.974 | 0.983 |
| 0.1320 | 0.938 | 0.962 | 0.975 |

Legend:

- A = Fouling factors (m² °C / kW)
- B = Cooling capacity correction factor
- C = Power input correction factor
- D = EER correction factor

Water content in cooling circuits The cooled water distribution circuits should have minimum water content to avoid excessive compressors start and stop. In fact, each time the compressor starts up, an excessive quantity of oil goes from the compressor sump and simultaneously there is a rise in the temperature of the compressor motor's stator due to the inrush current during the start-up. To prevent damage to the compressors, have been envisaged the application of a device to limit frequent stops and restarts. During the span of one hour there will be no more than 6 starts of the compressor. The plant side should therefore ensure that the overall water content allows a more constant functioning of the unit and consequently greater environmental comfort.

Water charge, flow and quality

| DAE Water quality requirements | BPHE |
|---|--|
| Ph (25 °C) | 7.5 – 9.0 |
| Electrical conductivity [µS/cm] (25°C) | < 500 |
| Chloride ion [mg Cl ⁻ / l] | < 70 (HP ¹); < 300 (CO ²) |
| Sulphate ion [mg SO ₄ ²⁻ / l] | < 100 |
| Alkalinity [mg CaCO ₃ / l] | < 200 |
| Total Hardness [mg CaCO ₃ / l] | 75 ÷ 150 |
| Iron [mg Fe / l] | < 0.2 |
| Ammonium ion [mg NH ⁴⁺ / l] | < 0.5 |
| Silica [mg SiO ₂ / l] | - |
| Chlorine molecular (mg Cl ₂ /l) | < 0.5 |

- Note: 1. Heat Pump
2. Cooling Only

EWLQ G-SS

| | | 090 | | | | | | 100 | | | | | |
|-----|----------|------|------|------|------|------|------|------|------|------|------|------|------|
| Twe | Tc | 30 | 35 | 40 | 45 | 50 | 55 | 30 | 35 | 40 | 45 | 50 | 55 |
| 5 | CC kW | 93.3 | 89.7 | 85.6 | 81.1 | 76.3 | 71.1 | 107 | 102 | 97.4 | 92.2 | 86.6 | 80.9 |
| | PI kW | 16.6 | 18.5 | 20.3 | 22.2 | 24.3 | 26.7 | 19.4 | 21.3 | 23.4 | 25.6 | 28.2 | 31.3 |
| | qwe l/s | 4.5 | 4.3 | 4.1 | 3.9 | 3.7 | 3.4 | 5.1 | 4.9 | 4.7 | 4.4 | 4.2 | 3.9 |
| | dpwe kPa | 51 | 47 | 43 | 39 | 34 | 29 | 52 | 47 | 43 | 38 | 34 | 29 |
| 7 | CC kW | 99.1 | 95.3 | 91.1 | 86.5 | 81.4 | 76 | 114 | 109 | 104 | 98.4 | 92.6 | 86.6 |
| | PI kW | 16.6 | 18.5 | 20.4 | 22.4 | 24.5 | 26.8 | 19.5 | 21.5 | 23.5 | 25.8 | 28.4 | 31.4 |
| | qwe l/s | 4.8 | 4.6 | 4.4 | 4.2 | 3.9 | 3.6 | 5.5 | 5.2 | 5.0 | 4.7 | 4.4 | 4.2 |
| | dpwe kPa | 57.7 | 53.3 | 48.7 | 43.8 | 38.8 | 33.7 | 58.4 | 53.5 | 48.6 | 43.6 | 38.6 | 33.7 |
| 9 | CC kW | 105 | 101 | 96.8 | 92 | 86.8 | 81.1 | 121 | 116 | 110 | 105 | 98.9 | 92.5 |
| | PI kW | 16.6 | 18.6 | 20.6 | 22.6 | 24.7 | 27 | 19.6 | 21.6 | 23.7 | 26 | 28.6 | 31.6 |
| | qwe l/s | 5.1 | 4.9 | 4.7 | 4.4 | 4.2 | 3.9 | 5.8 | 5.6 | 5.3 | 5.0 | 4.8 | 4.4 |
| | dpwe kPa | 65 | 60 | 55 | 50 | 44 | 39 | 66 | 61 | 55 | 50 | 44 | 39 |
| 11 | CC kW | | 107 | 103 | 97.7 | 92.3 | 86.4 | | 123 | 117 | 111 | 105 | 98.7 |
| | PI kW | 27 | 18.6 | 20.7 | 22.7 | 24.9 | 27.2 | 31.6 | 21.7 | 23.9 | 26.2 | 28.8 | 31.8 |
| | qwe l/s | | 5.2 | 4.9 | 4.7 | 4.4 | 4.2 | | 5.9 | 5.6 | 5.4 | 5.1 | 4.7 |
| | dpwe kPa | | 68 | 62 | 56 | 50 | 44 | | 68 | 62 | 56 | 50 | 44 |
| 13 | CC kW | | 114 | 109 | 104 | 98 | 91.9 | | 130 | 124 | 118 | 112 | 105 |
| | PI kW | 27.2 | 18.6 | 20.7 | 22.9 | 25 | 27.4 | 31.8 | 21.9 | 24 | 26.4 | 29 | 31.9 |
| | qwe l/s | | 5.5 | 5.2 | 5.0 | 4.7 | 4.4 | | 6.3 | 6.0 | 5.7 | 5.4 | 5.1 |
| | dpwe kPa | | 76 | 70 | 63 | 57 | 50 | | 77 | 70 | 64 | 57 | 50 |
| 15 | CC kW | | 120 | 115 | 110 | 104 | 97.6 | | 138 | 132 | 125 | 119 | 112 |
| | PI kW | 27.4 | 18.6 | 20.8 | 23 | 25.2 | 27.6 | 31.9 | 22 | 24.2 | 26.6 | 29.2 | 32.1 |
| | qwe l/s | | 5.8 | 5.6 | 5.3 | 5.0 | 4.7 | | 6.7 | 6.3 | 6.1 | 5.7 | 5.4 |
| | dpwe kPa | | 86 | 79 | 71 | 64 | 56 | | 87 | 79 | 72 | 64 | 57 |

| | | 120 | | | | | | 130 | | | | | |
|-----|----------|------|------|------|------|------|------|------|------|------|------|------|------|
| Twe | Tc | 30 | 35 | 40 | 45 | 50 | 55 | 30 | 35 | 40 | 45 | 50 | 55 |
| 5 | CC kW | 121 | 115 | 109 | 103 | 96.9 | 90.6 | 138 | 131 | 124 | 117 | 109 | 101 |
| | PI kW | 22.1 | 24.1 | 26.3 | 29 | 32.1 | 35.8 | 24.9 | 27.2 | 29.8 | 32.8 | 36.3 | 40.3 |
| | qwe l/s | 5.8 | 5.5 | 5.2 | 4.9 | 4.6 | 4.3 | 6.6 | 6.3 | 5.9 | 5.6 | 5.2 | 4.8 |
| | dpwe kPa | 42 | 38 | 34 | 31 | 27 | 24 | 36 | 32 | 29 | 26 | 22 | 19 |
| 7 | CC kW | 129 | 123 | 117 | 110 | 104 | 97.1 | 147 | 140 | 133 | 125 | 117 | 108 |
| | PI kW | 22.3 | 24.3 | 26.5 | 29.2 | 32.3 | 35.9 | 25.1 | 27.4 | 30 | 33 | 36.4 | 40.4 |
| | qwe l/s | 6.2 | 5.9 | 5.6 | 5.3 | 5.0 | 4.7 | 7.1 | 6.7 | 6.4 | 6.0 | 5.6 | 5.2 |
| | dpwe kPa | 48.0 | 43.6 | 39.2 | 35.0 | 31.0 | 27.1 | 40.8 | 37.0 | 33.2 | 29.4 | 25.8 | 22.1 |
| 9 | CC kW | 137 | 131 | 125 | 118 | 111 | 104 | 157 | 149 | 142 | 134 | 125 | 116 |
| | PI kW | 22.6 | 24.5 | 26.8 | 29.4 | 32.4 | 36.1 | 25.4 | 27.6 | 30.2 | 33.1 | 36.6 | 40.6 |
| | qwe l/s | 6.6 | 6.3 | 6.0 | 5.7 | 5.3 | 5.0 | 7.5 | 7.2 | 6.8 | 6.4 | 6.0 | 5.6 |
| | dpwe kPa | 55 | 50 | 45 | 40 | 36 | 31 | 46 | 42 | 38 | 34 | 30 | 25 |
| 11 | CC kW | | 140 | 133 | 126 | 118 | 111 | | 159 | 151 | 143 | 134 | 124 |
| | PI kW | 36.1 | 24.8 | 27 | 29.6 | 32.6 | 36.2 | 40.6 | 27.9 | 30.4 | 33.4 | 36.8 | 40.7 |
| | qwe l/s | | 6.7 | 6.4 | 6.0 | 5.7 | 5.3 | | 7.6 | 7.3 | 6.8 | 6.4 | 6.0 |
| | dpwe kPa | | 56 | 51 | 46 | 41 | 36 | | 48 | 43 | 38 | 34 | 29 |
| 13 | CC kW | | 148 | 141 | 134 | 126 | 118 | | 169 | 161 | 152 | 142 | 133 |
| | PI kW | 36.2 | 25 | 27.2 | 29.8 | 32.8 | 36.4 | 40.7 | 28.1 | 30.6 | 33.6 | 37 | 40.9 |
| | qwe l/s | | 7.1 | 6.8 | 6.4 | 6.1 | 5.7 | | 8.1 | 7.7 | 7.3 | 6.8 | 6.4 |
| | dpwe kPa | | 64 | 58 | 52 | 46 | 41 | | 54 | 49 | 44 | 38 | 33 |
| 15 | CC kW | | 158 | 150 | 142 | 134 | 126 | | 179 | 170 | 161 | 152 | 141 |
| | PI kW | 36.4 | 25.3 | 27.5 | 30.1 | 33.1 | 36.6 | 40.9 | 28.4 | 30.9 | 33.8 | 37.2 | 41.1 |
| | qwe l/s | | 7.6 | 7.2 | 6.8 | 6.5 | 6.1 | | 8.6 | 8.2 | 7.8 | 7.3 | 6.8 |
| | dpwe kPa | | 72 | 65 | 59 | 52 | 46 | | 61 | 55 | 49 | 44 | 38 |

EWLQ G-SS

| | | 150 | | | | | | 170 | | | | | |
|-----|----------|------|------|------|------|------|------|------|------|------|------|------|------|
| Twe | Tc | 30 | 35 | 40 | 45 | 50 | 55 | 30 | 35 | 40 | 45 | 50 | 55 |
| 5 | CC kW | 153 | 146 | 138 | 130 | 122 | 113 | 175 | 167 | 158 | 149 | 140 | 130 |
| | PI kW | 27.6 | 30.2 | 33.2 | 36.6 | 40.5 | 44.8 | 31.6 | 34.6 | 37.9 | 41.8 | 46.3 | 51.4 |
| | qwe l/s | 7.3 | 7.0 | 6.6 | 6.2 | 5.8 | 5.4 | 8.4 | 8.0 | 7.6 | 7.2 | 6.7 | 6.2 |
| | dpwe kPa | 35 | 32 | 29 | 25 | 22 | 19 | 37 | 34 | 30 | 27 | 24 | 20 |
| 7 | CC kW | 163 | 155 | 148 | 139 | 130 | 121 | 186 | 178 | 169 | 160 | 150 | 139 |
| | PI kW | 27.9 | 30.5 | 33.4 | 36.8 | 40.6 | 45 | 31.9 | 34.8 | 38.2 | 42 | 46.5 | 51.5 |
| | qwe l/s | 7.8 | 7.4 | 7.1 | 6.7 | 6.2 | 5.8 | 8.9 | 8.5 | 8.1 | 7.7 | 7.2 | 6.6 |
| | dpwe kPa | 39.9 | 36.3 | 32.7 | 29.1 | 25.5 | 21.9 | 42.1 | 38.3 | 34.6 | 30.8 | 27.0 | 23.3 |
| 9 | CC kW | 173 | 166 | 157 | 149 | 139 | 129 | 199 | 190 | 180 | 170 | 160 | 148 |
| | PI kW | 28.2 | 30.7 | 33.6 | 37 | 40.8 | 45.1 | 32.3 | 35.1 | 38.5 | 42.3 | 46.7 | 51.7 |
| | qwe l/s | 8.3 | 7.9 | 7.6 | 7.1 | 6.7 | 6.2 | 9.5 | 9.1 | 8.6 | 8.2 | 7.7 | 7.1 |
| | dpwe kPa | 45 | 41 | 37 | 33 | 29 | 25 | 48 | 44 | 39 | 35 | 31 | 27 |
| 11 | CC kW | | 176 | 168 | 158 | 148 | 138 | | 202 | 192 | 181 | 170 | 158 |
| | PI kW | 45.1 | 31 | 33.8 | 37.1 | 40.9 | 45.3 | 51.7 | 35.5 | 38.8 | 42.6 | 46.9 | 51.9 |
| | qwe l/s | | 8.5 | 8.1 | 7.6 | 7.1 | 6.6 | | 9.7 | 9.2 | 8.7 | 8.2 | 7.6 |
| | dpwe kPa | | 47 | 42 | 38 | 33 | 29 | | 50 | 45 | 40 | 35 | 30 |
| 13 | CC kW | | 187 | 178 | 169 | 158 | 147 | | 215 | 204 | 193 | 181 | 169 |
| | PI kW | 45.3 | 31.2 | 34.1 | 37.4 | 41.1 | 45.4 | 51.9 | 35.8 | 39.1 | 42.8 | 47.2 | 52.2 |
| | qwe l/s | | 9.0 | 8.6 | 8.1 | 7.6 | 7.1 | | 10.3 | 9.8 | 9.3 | 8.7 | 8.1 |
| | dpwe kPa | | 53 | 48 | 43 | 38 | 33 | | 56 | 51 | 45 | 40 | 35 |
| 15 | CC kW | | 199 | 189 | 179 | 168 | 157 | | 228 | 217 | 205 | 193 | 179 |
| | PI kW | 45.4 | 31.5 | 34.3 | 37.6 | 41.3 | 45.6 | 52.2 | 36.2 | 39.4 | 43.2 | 47.5 | 52.4 |
| | qwe l/s | | 9.6 | 9.1 | 8.6 | 8.1 | 7.5 | | 11.0 | 10.4 | 9.9 | 9.3 | 8.6 |
| | dpwe kPa | | 60 | 54 | 49 | 43 | 37 | | 63 | 57 | 51 | 45 | 39 |

| | | 190 | | | | | | 210 | | | | | |
|-----|----------|------|------|------|------|------|------|------|------|------|------|------|------|
| Twe | Tc | 30 | 35 | 40 | 45 | 50 | 55 | 30 | 35 | 40 | 45 | 50 | 55 |
| 5 | CC kW | 197 | 189 | 179 | 170 | 159 | 149 | 226 | 215 | 204 | 193 | 180 | 167 |
| | PI kW | 35.3 | 38.6 | 42.3 | 46.7 | 51.7 | 57.4 | 41.5 | 45.1 | 49.2 | 53.8 | 59.3 | 65.6 |
| | qwe l/s | 9.4 | 9.0 | 8.6 | 8.1 | 7.6 | 7.1 | 10.8 | 10.3 | 9.8 | 9.2 | 8.6 | 8.0 |
| | dpwe kPa | 39 | 36 | 32 | 29 | 26 | 22 | 36 | 33 | 29 | 26 | 23 | 20 |
| 7 | CC kW | 210 | 201 | 191 | 181 | 170 | 159 | 241 | 230 | 218 | 206 | 192 | 178 |
| | PI kW | 35.7 | 38.9 | 42.6 | 47 | 51.9 | 57.6 | 41.9 | 45.5 | 49.5 | 54.2 | 59.5 | 65.8 |
| | qwe l/s | 10.1 | 9.6 | 9.2 | 8.7 | 8.2 | 7.6 | 11.5 | 11.0 | 10.4 | 9.8 | 9.2 | 8.5 |
| | dpwe kPa | 44.5 | 40.7 | 36.9 | 33.0 | 29.2 | 25.5 | 40.8 | 37.2 | 33.5 | 29.8 | 26.1 | 22.4 |
| 9 | CC kW | 224 | 214 | 204 | 193 | 182 | 170 | 256 | 245 | 232 | 219 | 205 | 190 |
| | PI kW | 36 | 39.3 | 43 | 47.2 | 52.2 | 57.9 | 42.4 | 45.9 | 49.9 | 54.5 | 59.8 | 66 |
| | qwe l/s | 10.7 | 10.3 | 9.8 | 9.3 | 8.7 | 8.1 | 12.3 | 11.7 | 11.1 | 10.5 | 9.8 | 9.1 |
| | dpwe kPa | 51 | 46 | 42 | 38 | 33 | 29 | 47 | 42 | 38 | 34 | 30 | 26 |
| 11 | CC kW | | 228 | 217 | 206 | 194 | 182 | | 260 | 248 | 234 | 219 | 203 |
| | PI kW | 57.9 | 39.7 | 43.3 | 47.6 | 52.5 | 58.1 | 66 | 46.4 | 50.3 | 54.9 | 60.1 | 66.3 |
| | qwe l/s | | 10.9 | 10.4 | 9.9 | 9.3 | 8.7 | | 12.5 | 11.9 | 11.2 | 10.5 | 9.7 |
| | dpwe kPa | | 53 | 48 | 43 | 38 | 33 | | 48 | 43 | 39 | 34 | 29 |
| 13 | CC kW | | 242 | 231 | 219 | 207 | 194 | | 277 | 263 | 249 | 233 | 216 |
| | PI kW | 58.1 | 40.1 | 43.7 | 47.9 | 52.8 | 58.5 | 66.3 | 46.8 | 50.8 | 55.3 | 60.5 | 66.5 |
| | qwe l/s | | 11.6 | 11.1 | 10.5 | 9.9 | 9.3 | | 13.3 | 12.6 | 11.9 | 11.2 | 10.4 |
| | dpwe kPa | | 59 | 54 | 49 | 43 | 38 | | 54 | 49 | 44 | 39 | 33 |
| 15 | CC kW | | 257 | 245 | 233 | 220 | 206 | | 294 | 280 | 264 | 248 | 230 |
| | PI kW | 58.5 | 40.6 | 44.2 | 48.4 | 53.2 | 58.8 | 66.5 | 47.3 | 51.2 | 55.7 | 60.8 | 66.8 |
| | qwe l/s | | 12.4 | 11.8 | 11.2 | 10.6 | 9.9 | | 14.1 | 13.4 | 12.7 | 11.9 | 11.1 |
| | dpwe kPa | | 67 | 61 | 55 | 49 | 43 | | 62 | 56 | 50 | 44 | 38 |

EWLQ G-SS

| | | 240 | | | | | | 300 | | | | | |
|-----|----------|------|------|------|------|------|------|------|------|------|------|------|------|
| Twe | Tc | 30 | 35 | 40 | 45 | 50 | 55 | 30 | 35 | 40 | 45 | 50 | 55 |
| 5 | CC kW | 250 | 240 | 228 | 216 | 204 | 190 | 314 | 301 | 287 | 272 | 256 | 239 |
| | PI kW | 45.6 | 49.6 | 54.1 | 59.4 | 65.3 | 72 | 57.2 | 62.3 | 68.2 | 75.1 | 83 | 92 |
| | qwe l/s | 12.0 | 11.5 | 10.9 | 10.3 | 9.7 | 9.1 | 15.0 | 14.4 | 13.7 | 13.0 | 12.2 | 11.4 |
| | dpwe kPa | 44 | 40 | 37 | 33 | 29 | 25 | 48 | 44 | 40 | 36 | 32 | 28 |
| 7 | CC kW | 266 | 255 | 243 | 231 | 217 | 203 | 335 | 321 | 306 | 290 | 274 | 256 |
| | PI kW | 46.4 | 50.2 | 54.7 | 59.9 | 65.8 | 72.5 | 58 | 63 | 68.8 | 75.6 | 83.4 | 92.3 |
| | qwe l/s | 12.8 | 12.2 | 11.7 | 11.1 | 10.4 | 9.7 | 16.0 | 15.4 | 14.7 | 13.9 | 13.1 | 12.3 |
| | dpwe kPa | 50.1 | 46.0 | 41.8 | 37.6 | 33.3 | 29.1 | 54.9 | 50.5 | 45.9 | 41.3 | 36.6 | 32.0 |
| 9 | CC kW | 283 | 272 | 259 | 246 | 232 | 217 | 356 | 341 | 326 | 310 | 292 | 273 |
| | PI kW | 47.3 | 51 | 55.4 | 60.5 | 66.4 | 73 | 58.9 | 63.8 | 69.5 | 76.2 | 83.9 | 92.7 |
| | qwe l/s | 13.6 | 13.0 | 12.4 | 11.8 | 11.1 | 10.4 | 17.1 | 16.4 | 15.6 | 14.9 | 14.0 | 13.1 |
| | dpwe kPa | 57 | 52 | 48 | 43 | 38 | 33 | 62 | 57 | 52 | 47 | 42 | 37 |
| 11 | CC kW | 289 | 276 | 262 | 247 | 232 | 217 | 363 | 347 | 330 | 311 | 292 | 273 |
| | PI kW | 73 | 51.9 | 56.2 | 61.2 | 67 | 73.6 | 92.7 | 64.7 | 70.3 | 76.8 | 84.5 | 93.2 |
| | qwe l/s | 13.9 | 13.2 | 12.6 | 11.9 | 11.1 | 10.4 | 17.4 | 16.6 | 15.8 | 14.9 | 14.0 | 13.1 |
| | dpwe kPa | 59 | 54 | 49 | 43 | 38 | 33 | 65 | 59 | 54 | 48 | 42 | 37 |
| 13 | CC kW | 306 | 293 | 278 | 263 | 247 | 232 | 385 | 368 | 350 | 332 | 311 | 292 |
| | PI kW | 73.6 | 52.8 | 57 | 62 | 67.6 | 74.1 | 93.2 | 65.6 | 71.1 | 77.6 | 85.1 | 93.7 |
| | qwe l/s | 14.7 | 14.1 | 13.4 | 12.6 | 11.9 | 11.1 | 18.5 | 17.7 | 16.9 | 15.9 | 14.9 | 13.9 |
| | dpwe kPa | 67 | 61 | 55 | 49 | 43 | 38 | 73 | 67 | 61 | 54 | 48 | 42 |
| 15 | CC kW | 325 | 311 | 296 | 279 | 262 | 247 | 408 | 391 | 372 | 352 | 331 | 311 |
| | PI kW | 74.1 | 53.9 | 58 | 62.8 | 68.4 | 74.8 | 93.7 | 66.7 | 72 | 78.4 | 85.8 | 94.3 |
| | qwe l/s | 15.6 | 15.0 | 14.2 | 13.4 | 12.6 | 11.9 | 19.7 | 18.8 | 17.9 | 17.0 | 15.9 | 14.9 |
| | dpwe kPa | 75 | 69 | 62 | 56 | 49 | 43 | 83 | 76 | 68 | 61 | 54 | 48 |

| | | 360 | | | | | | | | | | | |
|-----|----------|------|------|------|------|------|------|-----|-----|-----|-----|-----|-----|
| Twe | Tc | 30 | 35 | 40 | 45 | 50 | 55 | Ta1 | Ta2 | Ta3 | Ta4 | Ta5 | Ta6 |
| 5 | CC kW | 374 | 359 | 342 | 324 | 306 | 286 | | | | | | |
| | PI kW | 69 | 75.3 | 82.8 | 91.4 | 101 | 113 | | | | | | |
| | qwe l/s | 17.9 | 17.1 | 16.4 | 15.5 | 14.6 | 13.6 | | | | | | |
| | dpwe kPa | 48 | 44 | 40 | 36 | 32 | 28 | | | | | | |
| 7 | CC kW | 398 | 382 | 365 | 346 | 326 | 305 | | | | | | |
| | PI kW | 69.8 | 76 | 83.3 | 91.8 | 102 | 113 | | | | | | |
| | qwe l/s | 19.1 | 18.3 | 17.5 | 16.6 | 15.6 | 14.6 | | | | | | |
| | dpwe kPa | 54.8 | 50.4 | 45.9 | 41.3 | 36.7 | 32.1 | | | | | | |
| 9 | CC kW | 423 | 406 | 388 | 369 | 348 | 326 | | | | | | |
| | PI kW | 70.7 | 76.7 | 83.9 | 92.3 | 102 | 113 | | | | | | |
| | qwe l/s | 20.3 | 19.5 | 18.6 | 17.7 | 16.7 | 15.6 | | | | | | |
| | dpwe kPa | 62 | 57 | 52 | 47 | 42 | 37 | | | | | | |
| 11 | CC kW | 432 | 413 | 393 | 371 | 348 | 326 | | | | | | |
| | PI kW | 113 | 77.6 | 84.6 | 92.9 | 102 | 113 | | | | | | |
| | qwe l/s | 20.7 | 19.8 | 18.9 | 17.8 | 16.7 | 15.6 | | | | | | |
| | dpwe kPa | 65 | 59 | 53 | 48 | 42 | 37 | | | | | | |
| 13 | CC kW | 458 | 438 | 417 | 395 | 371 | 348 | | | | | | |
| | PI kW | 113 | 78.5 | 85.4 | 93.5 | 103 | 114 | | | | | | |
| | qwe l/s | 22.0 | 21.1 | 20.0 | 19.0 | 17.8 | 16.7 | | | | | | |
| | dpwe kPa | 73 | 67 | 61 | 54 | 48 | 42 | | | | | | |
| 15 | CC kW | 486 | 465 | 443 | 420 | 395 | 371 | | | | | | |
| | PI kW | 114 | 79.6 | 86.3 | 94.2 | 104 | 114 | | | | | | |
| | qwe l/s | 23.4 | 22.4 | 21.3 | 20.2 | 19.0 | 17.8 | | | | | | |
| | dpwe kPa | 82 | 75 | 68 | 61 | 54 | 48 | | | | | | |

Fluid: Water
 Twe: Evaporator leaving water temperature (Δt 5°C); Tc: Condensing temperature;
 qwc: Fluid flow rate at condenser; dpwc: Fluid pressure drop at condenser
 * For working condition where dpw value is "Italic-Red Color" please contact factory

EWLQ L-SS

| | | 180 | | | | | | 205 | | | | | |
|-----|----------|------|------|------|------|------|------|------|------|------|------|------|------|
| Twe | Tc | 30 | 35 | 40 | 45 | 50 | 55 | 30 | 35 | 40 | 45 | 50 | 55 |
| 5 | CC kW | 187 | 180 | 171 | 162 | 153 | 142 | 215 | 206 | 195 | 185 | 174 | 162 |
| | PI kW | 32.7 | 36.4 | 40.2 | 44.1 | 48.3 | 53.1 | 38.3 | 42.1 | 46.2 | 50.8 | 56.1 | 62.2 |
| | qwe l/s | 8.9 | 8.6 | 8.2 | 7.8 | 7.3 | 6.8 | 10.3 | 9.8 | 9.3 | 8.8 | 8.3 | 7.8 |
| | dpwe kPa | 30 | 27 | 25 | 22 | 20 | 17 | 29 | 27 | 24 | 21 | 19 | 17 |
| 7 | CC kW | 199 | 191 | 183 | 173 | 163 | 152 | 229 | 219 | 209 | 197 | 186 | 174 |
| | PI kW | 32.7 | 36.5 | 40.4 | 44.3 | 48.6 | 53.4 | 38.4 | 42.3 | 46.5 | 51.1 | 56.4 | 62.5 |
| | qwe l/s | 9.5 | 9.1 | 8.7 | 8.3 | 7.8 | 7.3 | 11.0 | 10.5 | 10.0 | 9.4 | 8.9 | 8.3 |
| | dpwe kPa | 33.6 | 31.0 | 28.2 | 25.4 | 22.5 | 19.6 | 33.0 | 30.2 | 27.3 | 24.5 | 21.7 | 18.9 |
| 9 | CC kW | 211 | 203 | 194 | 184 | 174 | 162 | 244 | 233 | 222 | 211 | 198 | 186 |
| | PI kW | 32.5 | 36.6 | 40.6 | 44.6 | 48.9 | 53.7 | 38.5 | 42.5 | 46.8 | 51.5 | 56.7 | 62.7 |
| | qwe l/s | 10.1 | 9.7 | 9.3 | 8.8 | 8.3 | 7.8 | 11.7 | 11.2 | 10.6 | 10.1 | 9.5 | 8.9 |
| | dpwe kPa | 38 | 35 | 32 | 29 | 26 | 22 | 37 | 34 | 31 | 28 | 25 | 22 |
| 11 | CC kW | | 216 | 206 | 196 | 185 | 173 | | 248 | 236 | 224 | 211 | 198 |
| | PI kW | 53.7 | 36.6 | 40.7 | 44.9 | 49.2 | 54 | 62.7 | 42.8 | 47.1 | 51.8 | 57 | 63 |
| | qwe l/s | | 10.4 | 9.9 | 9.4 | 8.9 | 8.3 | | 11.9 | 11.3 | 10.8 | 10.1 | 9.5 |
| | dpwe kPa | | 40 | 36 | 33 | 29 | 25 | | 39 | 35 | 32 | 28 | 25 |
| 13 | CC kW | | 229 | 219 | 208 | 197 | 184 | | 263 | 251 | 238 | 225 | 211 |
| | PI kW | 54 | 36.5 | 40.8 | 45.1 | 49.5 | 54.3 | 63 | 42.9 | 47.3 | 52.1 | 57.4 | 63.3 |
| | qwe l/s | | 11.0 | 10.5 | 10.0 | 9.4 | 8.8 | | 12.6 | 12.1 | 11.4 | 10.8 | 10.1 |
| | dpwe kPa | | 45 | 41 | 37 | 33 | 29 | | 44 | 40 | 36 | 32 | 28 |
| 15 | CC kW | | 242 | 232 | 221 | 209 | 196 | | 279 | 267 | 253 | 239 | 225 |
| | PI kW | 54.3 | 36.3 | 40.8 | 45.3 | 49.8 | 54.6 | 63.3 | 43.1 | 47.6 | 52.4 | 57.7 | 63.7 |
| | qwe l/s | | 11.6 | 11.1 | 10.6 | 10.0 | 9.4 | | 13.4 | 12.8 | 12.2 | 11.5 | 10.8 |
| | dpwe kPa | | 50 | 46 | 42 | 37 | 33 | | 49 | 45 | 41 | 36 | 32 |

| | | 230 | | | | | | 260 | | | | | |
|-----|----------|------|------|------|------|------|------|------|------|------|------|------|------|
| Twe | Tc | 30 | 35 | 40 | 45 | 50 | 55 | 30 | 35 | 40 | 45 | 50 | 55 |
| 5 | CC kW | 246 | 234 | 222 | 209 | 197 | 184 | 274 | 261 | 247 | 233 | 218 | 202 |
| | PI kW | 43.8 | 47.7 | 52.3 | 57.6 | 63.9 | 71.3 | 49.4 | 54 | 59.2 | 65.3 | 72.3 | 80.4 |
| | qwe l/s | 11.7 | 11.2 | 10.6 | 10.0 | 9.4 | 8.8 | 13.1 | 12.5 | 11.8 | 11.1 | 10.4 | 9.6 |
| | dpwe kPa | 24 | 22 | 20 | 18 | 16 | 14 | 30 | 28 | 25 | 22 | 19 | 17 |
| 7 | CC kW | 262 | 250 | 237 | 224 | 210 | 197 | 292 | 278 | 264 | 249 | 233 | 216 |
| | PI kW | 44.1 | 48.1 | 52.6 | 57.9 | 64.2 | 71.5 | 49.8 | 54.4 | 59.6 | 65.6 | 72.6 | 80.6 |
| | qwe l/s | 12.5 | 11.9 | 11.3 | 10.7 | 10.1 | 9.4 | 14.0 | 13.3 | 12.6 | 11.9 | 11.1 | 10.3 |
| | dpwe kPa | 27.8 | 25.2 | 22.7 | 20.3 | 17.9 | 15.7 | 34.5 | 31.3 | 28.2 | 25.0 | 22.0 | 18.9 |
| 9 | CC kW | 279 | 266 | 253 | 239 | 225 | 211 | 311 | 296 | 281 | 265 | 249 | 231 |
| | PI kW | 44.6 | 48.5 | 53 | 58.3 | 64.5 | 71.8 | 50.3 | 54.8 | 60 | 65.9 | 72.9 | 80.9 |
| | qwe l/s | 13.4 | 12.8 | 12.1 | 11.4 | 10.8 | 10.1 | 14.9 | 14.2 | 13.5 | 12.7 | 11.9 | 11.1 |
| | dpwe kPa | 32 | 29 | 26 | 23 | 21 | 18 | 39 | 36 | 32 | 29 | 25 | 22 |
| 11 | CC kW | | 284 | 269 | 255 | 240 | 225 | | 315 | 299 | 283 | 265 | 247 |
| | PI kW | 71.8 | 48.9 | 53.4 | 58.6 | 64.8 | 72.1 | 80.9 | 55.2 | 60.3 | 66.3 | 73.2 | 81.2 |
| | qwe l/s | | 13.6 | 12.9 | 12.2 | 11.5 | 10.8 | | 15.1 | 14.4 | 13.6 | 12.7 | 11.8 |
| | dpwe kPa | | 33 | 30 | 26 | 24 | 21 | | 41 | 37 | 33 | 29 | 25 |
| 13 | CC kW | | 302 | 287 | 272 | 256 | 240 | | 335 | 319 | 301 | 283 | 263 |
| | PI kW | 72.1 | 49.4 | 53.8 | 59 | 65.2 | 72.4 | 81.2 | 55.7 | 60.8 | 66.7 | 73.5 | 81.4 |
| | qwe l/s | | 14.5 | 13.8 | 13.0 | 12.3 | 11.5 | | 16.1 | 15.3 | 14.4 | 13.6 | 12.6 |
| | dpwe kPa | | 37 | 34 | 30 | 27 | 24 | | 46 | 41 | 37 | 33 | 28 |
| 15 | CC kW | | 320 | 305 | 289 | 273 | 256 | | 356 | 338 | 320 | 301 | 281 |
| | PI kW | 72.4 | 49.9 | 54.3 | 59.5 | 65.6 | 72.7 | 81.4 | 56.3 | 61.3 | 67.1 | 73.9 | 81.7 |
| | qwe l/s | | 15.4 | 14.6 | 13.9 | 13.1 | 12.3 | | 17.1 | 16.3 | 15.4 | 14.4 | 13.5 |
| | dpwe kPa | | 42 | 38 | 34 | 30 | 27 | | 52 | 47 | 42 | 37 | 32 |

EWLQ L-SS

| | | 290 | | | | | | 330 | | | | | |
|-----|----------|------|------|------|------|------|------|------|------|------|------|------|------|
| Twe | Tc | 30 | 35 | 40 | 45 | 50 | 55 | 30 | 35 | 40 | 45 | 50 | 55 |
| 5 | CC kW | 306 | 292 | 277 | 261 | 244 | 226 | 346 | 330 | 314 | 297 | 278 | 258 |
| | PI kW | 54.9 | 60.1 | 66.1 | 72.9 | 80.7 | 89.5 | 62.8 | 68.8 | 75.6 | 83.4 | 92.3 | 103 |
| | qwe l/s | 14.6 | 13.9 | 13.2 | 12.5 | 11.7 | 10.8 | 16.5 | 15.8 | 15.0 | 14.2 | 13.3 | 12.3 |
| | dpwe kPa | 27 | 25 | 22 | 20 | 17 | 15 | 34 | 31 | 28 | 25 | 22 | 19 |
| 7 | CC kW | 326 | 311 | 296 | 279 | 261 | 242 | 369 | 352 | 335 | 317 | 297 | 276 |
| | PI kW | 55.3 | 60.5 | 66.4 | 73.2 | 80.9 | 89.7 | 63.4 | 69.3 | 76 | 83.8 | 92.7 | 103 |
| | qwe l/s | 15.6 | 14.9 | 14.1 | 13.4 | 12.5 | 11.6 | 17.6 | 16.9 | 16.0 | 15.1 | 14.2 | 13.2 |
| | dpwe kPa | 30.6 | 27.9 | 25.2 | 22.4 | 19.6 | 16.9 | 39.2 | 35.7 | 32.3 | 28.8 | 25.4 | 21.9 |
| 9 | CC kW | 347 | 332 | 315 | 298 | 279 | 259 | 392 | 375 | 357 | 337 | 317 | 294 |
| | PI kW | 55.8 | 60.9 | 66.8 | 73.5 | 81.2 | 89.9 | 64.1 | 69.9 | 76.5 | 84.2 | 93 | 103 |
| | qwe l/s | 16.6 | 15.9 | 15.1 | 14.3 | 13.4 | 12.4 | 18.8 | 18.0 | 17.1 | 16.2 | 15.2 | 14.1 |
| | dpwe kPa | 35 | 32 | 29 | 26 | 22 | 19 | 45 | 41 | 37 | 33 | 29 | 25 |
| 11 | CC kW | | 353 | 336 | 317 | 298 | 277 | | 399 | 380 | 359 | 337 | 314 |
| | PI kW | 89.9 | 61.4 | 67.2 | 73.9 | 81.5 | 90.2 | 103 | 70.5 | 77.1 | 84.7 | 93.5 | 104 |
| | qwe l/s | | 16.9 | 16.1 | 15.2 | 14.3 | 13.3 | | 19.1 | 18.2 | 17.2 | 16.2 | 15.0 |
| | dpwe kPa | | 36 | 33 | 29 | 26 | 22 | | 46 | 42 | 37 | 33 | 28 |
| 13 | CC kW | | 375 | 357 | 338 | 317 | 295 | | 423 | 403 | 382 | 359 | 334 |
| | PI kW | 90.2 | 61.9 | 67.6 | 74.2 | 81.8 | 90.4 | 104 | 71.2 | 77.7 | 85.3 | 94 | 104 |
| | qwe l/s | | 18.0 | 17.1 | 16.2 | 15.2 | 14.1 | | 20.3 | 19.4 | 18.3 | 17.2 | 16.0 |
| | dpwe kPa | | 41 | 37 | 33 | 29 | 25 | | 52 | 47 | 42 | 37 | 32 |
| 15 | CC kW | | 398 | 379 | 359 | 337 | 314 | | 450 | 428 | 405 | 381 | 355 |
| | PI kW | 90.4 | 62.5 | 68.1 | 74.6 | 82.1 | 90.7 | 104 | 71.9 | 78.4 | 85.9 | 94.5 | 104 |
| | qwe l/s | | 19.1 | 18.2 | 17.2 | 16.2 | 15.1 | | 21.6 | 20.6 | 19.5 | 18.3 | 17.1 |
| | dpwe kPa | | 46 | 42 | 37 | 33 | 29 | | 59 | 53 | 48 | 42 | 37 |

| | | 380 | | | | | | 430 | | | | | |
|-----|----------|------|------|------|------|------|------|------|------|------|------|------|------|
| Twe | Tc | 30 | 35 | 40 | 45 | 50 | 55 | 30 | 35 | 40 | 45 | 50 | 55 |
| 5 | CC kW | 393 | 376 | 357 | 338 | 318 | 297 | 448 | 428 | 407 | 384 | 359 | 333 |
| | PI kW | 70.2 | 76.7 | 84.3 | 93 | 103 | 115 | 82.6 | 89.8 | 98 | 107 | 118 | 131 |
| | qwe l/s | 18.8 | 18.0 | 17.1 | 16.2 | 15.2 | 14.2 | 21.4 | 20.5 | 19.4 | 18.3 | 17.2 | 15.9 |
| | dpwe kPa | 34 | 31 | 28 | 25 | 22 | 19 | 35 | 32 | 29 | 25 | 22 | 19 |
| 7 | CC kW | 419 | 401 | 382 | 361 | 340 | 318 | 478 | 456 | 434 | 409 | 384 | 356 |
| | PI kW | 70.9 | 77.4 | 84.8 | 93.5 | 103 | 115 | 83.5 | 90.6 | 98.7 | 108 | 119 | 131 |
| | qwe l/s | 20.0 | 19.2 | 18.3 | 17.3 | 16.3 | 15.2 | 22.9 | 21.8 | 20.8 | 19.6 | 18.3 | 17.0 |
| | dpwe kPa | 38.7 | 35.4 | 32.1 | 28.7 | 25.4 | 22.2 | 39.5 | 36.0 | 32.5 | 29.0 | 25.4 | 21.8 |
| 9 | CC kW | 446 | 427 | 407 | 385 | 363 | 339 | 508 | 486 | 462 | 436 | 409 | 380 |
| | PI kW | 71.6 | 78.1 | 85.5 | 94.1 | 104 | 115 | 84.3 | 91.4 | 99.5 | 109 | 119 | 132 |
| | qwe l/s | 21.4 | 20.5 | 19.5 | 18.5 | 17.4 | 16.3 | 24.4 | 23.3 | 22.1 | 20.9 | 19.6 | 18.2 |
| | dpwe kPa | 44 | 40 | 37 | 33 | 29 | 25 | 45 | 41 | 37 | 33 | 29 | 25 |
| 11 | CC kW | | 454 | 433 | 410 | 387 | 362 | | 516 | 491 | 464 | 435 | 405 |
| | PI kW | 115 | 78.8 | 86.2 | 94.7 | 105 | 116 | 132 | 92.3 | 100 | 109 | 120 | 132 |
| | qwe l/s | | 21.8 | 20.8 | 19.7 | 18.5 | 17.4 | | 24.8 | 23.5 | 22.3 | 20.9 | 19.4 |
| | dpwe kPa | | 46 | 42 | 37 | 33 | 29 | | 46 | 42 | 37 | 33 | 28 |
| 13 | CC kW | | 482 | 460 | 437 | 412 | 386 | | 548 | 522 | 493 | 463 | 431 |
| | PI kW | 116 | 79.6 | 86.9 | 95.4 | 105 | 116 | 132 | 93.2 | 101 | 110 | 121 | 133 |
| | qwe l/s | | 23.2 | 22.1 | 21.0 | 19.8 | 18.5 | | 26.3 | 25.0 | 23.7 | 22.2 | 20.7 |
| | dpwe kPa | | 52 | 47 | 42 | 38 | 33 | | 52 | 47 | 42 | 37 | 32 |
| 15 | CC kW | | 512 | 489 | 464 | 438 | 411 | | 582 | 554 | 524 | 492 | 458 |
| | PI kW | 116 | 80.5 | 87.8 | 96.2 | 106 | 117 | 133 | 94.1 | 102 | 111 | 121 | 133 |
| | qwe l/s | | 24.6 | 23.5 | 22.3 | 21.0 | 19.7 | | 28.0 | 26.6 | 25.2 | 23.6 | 22.0 |
| | dpwe kPa | | 58 | 53 | 48 | 43 | 37 | | 59 | 53 | 48 | 42 | 37 |

EWLQ L-SS

| | | 480 | | | | | | 540 | | | | | |
|-----|----------|------|------|------|------|------|------|------|------|------|------|------|------|
| Twe | Tc | 30 | 35 | 40 | 45 | 50 | 55 | 30 | 35 | 40 | 45 | 50 | 55 |
| 5 | CC kW | 496 | 476 | 454 | 430 | 405 | 379 | 552 | 530 | 506 | 480 | 453 | 424 |
| | PI kW | 90.7 | 98.7 | 108 | 118 | 130 | 144 | 102 | 111 | 122 | 134 | 148 | 164 |
| | qwe l/s | 23.7 | 22.7 | 21.7 | 20.6 | 19.4 | 18.1 | 26.4 | 25.3 | 24.2 | 23.0 | 21.6 | 20.3 |
| | dpwe kPa | 43 | 39 | 36 | 32 | 28 | 25 | 53 | 49 | 44 | 40 | 35 | 31 |
| 7 | CC kW | 528 | 506 | 483 | 459 | 432 | 405 | 587 | 563 | 538 | 511 | 483 | 453 |
| | PI kW | 92.3 | 100 | 109 | 119 | 131 | 145 | 104 | 113 | 123 | 135 | 149 | 165 |
| | qwe l/s | 25.3 | 24.2 | 23.1 | 21.9 | 20.7 | 19.4 | 28.1 | 27.0 | 25.8 | 24.5 | 23.1 | 21.7 |
| | dpwe kPa | 48.3 | 44.4 | 40.4 | 36.4 | 32.3 | 28.3 | 59.7 | 55.0 | 50.1 | 45.3 | 40.3 | 35.4 |
| 9 | CC kW | 561 | 538 | 514 | 488 | 461 | 432 | 623 | 598 | 572 | 544 | 514 | 482 |
| | PI kW | 93.9 | 102 | 110 | 121 | 132 | 146 | 106 | 114 | 125 | 136 | 150 | 166 |
| | qwe l/s | 26.9 | 25.8 | 24.6 | 23.4 | 22.1 | 20.7 | 29.9 | 28.7 | 27.4 | 26.1 | 24.6 | 23.1 |
| | dpwe kPa | 55 | 50 | 46 | 41 | 37 | 32 | 68 | 62 | 57 | 51 | 46 | 40 |
| 11 | CC kW | | 571 | 546 | 519 | 490 | 460 | | 635 | 607 | 578 | 546 | 513 |
| | PI kW | 146 | 103 | 112 | 122 | 134 | 147 | 166 | 116 | 126 | 138 | 151 | 166 |
| | qwe l/s | | 27.4 | 26.2 | 24.9 | 23.5 | 22.0 | | 30.5 | 29.2 | 27.7 | 26.2 | 24.6 |
| | dpwe kPa | | 57 | 52 | 47 | 42 | 37 | | 70 | 64 | 58 | 52 | 46 |
| 13 | CC kW | | 606 | 579 | 551 | 521 | 489 | | 673 | 644 | 613 | 581 | 546 |
| | PI kW | 147 | 105 | 113 | 123 | 135 | 148 | 166 | 118 | 128 | 139 | 152 | 168 |
| | qwe l/s | | 29.1 | 27.8 | 26.5 | 25.0 | 23.5 | | 32.4 | 31.0 | 29.5 | 27.9 | 26.2 |
| | dpwe kPa | | 64 | 59 | 53 | 47 | 42 | | 79 | 73 | 66 | 59 | 52 |
| 15 | CC kW | | 642 | 614 | 585 | 553 | 520 | | 713 | 683 | 651 | 616 | 580 |
| | PI kW | 148 | 107 | 115 | 125 | 136 | 149 | 168 | 120 | 129 | 141 | 154 | 169 |
| | qwe l/s | | 30.9 | 29.5 | 28.1 | 26.6 | 25.0 | | 34.4 | 32.9 | 31.3 | 29.6 | 27.9 |
| | dpwe kPa | | 72 | 66 | 60 | 53 | 47 | | 89 | 82 | 74 | 66 | 59 |

| | | 600 | | | | | | 660 | | | | | |
|-----|----------|------|------|------|------|------|------|------|------|------|------|------|------|
| Twe | Tc | 30 | 35 | 40 | 45 | 50 | 55 | 30 | 35 | 40 | 45 | 50 | 55 |
| 5 | CC kW | 617 | 592 | 565 | 536 | 505 | 473 | 672 | 645 | 617 | 586 | 553 | 518 |
| | PI kW | 115 | 125 | 137 | 151 | 167 | 185 | 126 | 138 | 151 | 167 | 185 | 205 |
| | qwe l/s | 29.5 | 28.3 | 27.0 | 25.6 | 24.2 | 22.6 | 32.2 | 30.9 | 29.5 | 28.0 | 26.4 | 24.8 |
| | dpwe kPa | 51 | 47 | 43 | 39 | 34 | 30 | 61 | 56 | 51 | 46 | 41 | 36 |
| 7 | CC kW | 656 | 629 | 601 | 571 | 539 | 505 | 714 | 686 | 656 | 624 | 589 | 553 |
| | PI kW | 116 | 126 | 138 | 152 | 168 | 186 | 128 | 139 | 153 | 168 | 186 | 206 |
| | qwe l/s | 31.4 | 30.1 | 28.8 | 27.3 | 25.8 | 24.2 | 34.3 | 32.9 | 31.4 | 29.9 | 28.2 | 26.5 |
| | dpwe kPa | 57.9 | 53.3 | 48.6 | 43.8 | 39.0 | 34.2 | 68.8 | 63.4 | 57.9 | 52.3 | 46.7 | 41.0 |
| 9 | CC kW | 696 | 669 | 639 | 608 | 574 | 538 | 758 | 728 | 697 | 663 | 627 | 589 |
| | PI kW | 118 | 128 | 139 | 153 | 169 | 186 | 130 | 141 | 154 | 169 | 186 | 206 |
| | qwe l/s | 33.4 | 32.1 | 30.6 | 29.1 | 27.5 | 25.8 | 36.4 | 35.0 | 33.4 | 31.8 | 30.1 | 28.2 |
| | dpwe kPa | 65 | 60 | 55 | 50 | 44 | 39 | 78 | 72 | 66 | 59 | 53 | 47 |
| 11 | CC kW | | 709 | 679 | 646 | 611 | 573 | | 773 | 740 | 704 | 667 | 627 |
| | PI kW | 186 | 129 | 141 | 154 | 170 | 187 | 206 | 142 | 155 | 170 | 187 | 207 |
| | qwe l/s | | 34.1 | 32.6 | 31.0 | 29.3 | 27.5 | | 37.2 | 35.5 | 33.8 | 32.0 | 30.1 |
| | dpwe kPa | | 68 | 62 | 56 | 50 | 44 | | 81 | 74 | 67 | 60 | 53 |
| 13 | CC kW | | 752 | 720 | 685 | 649 | 610 | | 819 | 784 | 747 | 708 | 666 |
| | PI kW | 187 | 131 | 142 | 155 | 171 | 188 | 207 | 144 | 157 | 171 | 189 | 208 |
| | qwe l/s | | 36.2 | 34.6 | 32.9 | 31.2 | 29.3 | | 39.4 | 37.7 | 35.9 | 34.0 | 32.0 |
| | dpwe kPa | | 77 | 70 | 64 | 57 | 50 | | 91 | 84 | 76 | 68 | 60 |
| 15 | CC kW | | 797 | 763 | 727 | 689 | 648 | | 868 | 831 | 792 | 751 | 707 |
| | PI kW | 188 | 133 | 144 | 157 | 172 | 189 | 208 | 146 | 159 | 173 | 190 | 209 |
| | qwe l/s | | 38.4 | 36.7 | 35.0 | 33.1 | 31.2 | | 41.8 | 40.0 | 38.2 | 36.2 | 34.0 |
| | dpwe kPa | | 86 | 79 | 72 | 64 | 57 | | 103 | 94 | 85 | 77 | 68 |

EWLQ L-SS


| | | 720 | | | | | | | | | | | |
|-----------|----------|------|------|------|------|------|------|-----|-----|-----|-----|-----|-----|
| Twe | Tc | 30 | 35 | 40 | 45 | 50 | 55 | Ta1 | Ta2 | Ta3 | Ta4 | Ta5 | Ta6 |
| 5 | CC kW | 728 | 699 | 668 | 635 | 600 | 563 | | | | | | |
| | PI kW | 138 | 151 | 166 | 183 | 203 | 225 | | | | | | |
| | qwe l/s | 34.9 | 33.5 | 32.0 | 30.4 | 28.7 | 26.9 | | | | | | |
| | dpwe kPa | 71 | 66 | 60 | 54 | 48 | 43 | | | | | | |
| 7 | CC kW | 773 | 743 | 710 | 676 | 639 | 600 | | | | | | |
| | PI kW | 140 | 152 | 167 | 184 | 204 | 226 | | | | | | |
| | qwe l/s | 37.1 | 35.6 | 34.1 | 32.4 | 30.6 | 28.7 | | | | | | |
| | dpwe kPa | 80.6 | 74.4 | 68.0 | 61.5 | 55.0 | 48.4 | | | | | | |
| 9 | CC kW | 820 | 788 | 754 | 718 | 680 | 639 | | | | | | |
| | PI kW | 142 | 154 | 168 | 185 | 204 | 227 | | | | | | |
| | qwe l/s | 39.4 | 37.8 | 36.2 | 34.5 | 32.6 | 30.6 | | | | | | |
| | dpwe kPa | 91 | 84 | 77 | 70 | 62 | 55 | | | | | | |
| 11 | CC kW | | 836 | 800 | 762 | 722 | 680 | | | | | | |
| | PI kW | 227 | 156 | 170 | 186 | 205 | 227 | | | | | | |
| | qwe l/s | | 40.2 | 38.5 | 36.6 | 34.7 | 32.6 | | | | | | |
| | dpwe kPa | | 95 | 87 | 79 | 71 | 62 | | | | | | |
| 13 | CC kW | | 886 | 849 | 809 | 767 | 722 | | | | | | |
| | PI kW | 227 | 158 | 171 | 188 | 206 | 228 | | | | | | |
| | qwe l/s | | 42.7 | 40.9 | 38.9 | 36.9 | 34.7 | | | | | | |
| | dpwe kPa | | 107 | 98 | 89 | 80 | 71 | | | | | | |
| 15 | CC kW | | 938 | 899 | 858 | 814 | 767 | | | | | | |
| | PI kW | 228 | 160 | 173 | 189 | 208 | 229 | | | | | | |
| | qwe l/s | | 45.3 | 43.4 | 41.3 | 39.2 | 36.9 | | | | | | |
| | dpwe kPa | | 120 | 110 | 100 | 90 | 80 | | | | | | |


Fluid: Water

Twe: Evaporator leaving water temperature (Δt 5°C); Tc: Condensing temperature;

qwc: Fluid flow rate at condenser; dpwc: Fluid pressure drop at condenser

* For working condition where dpw value is "Italic-Red Color" please contact factory




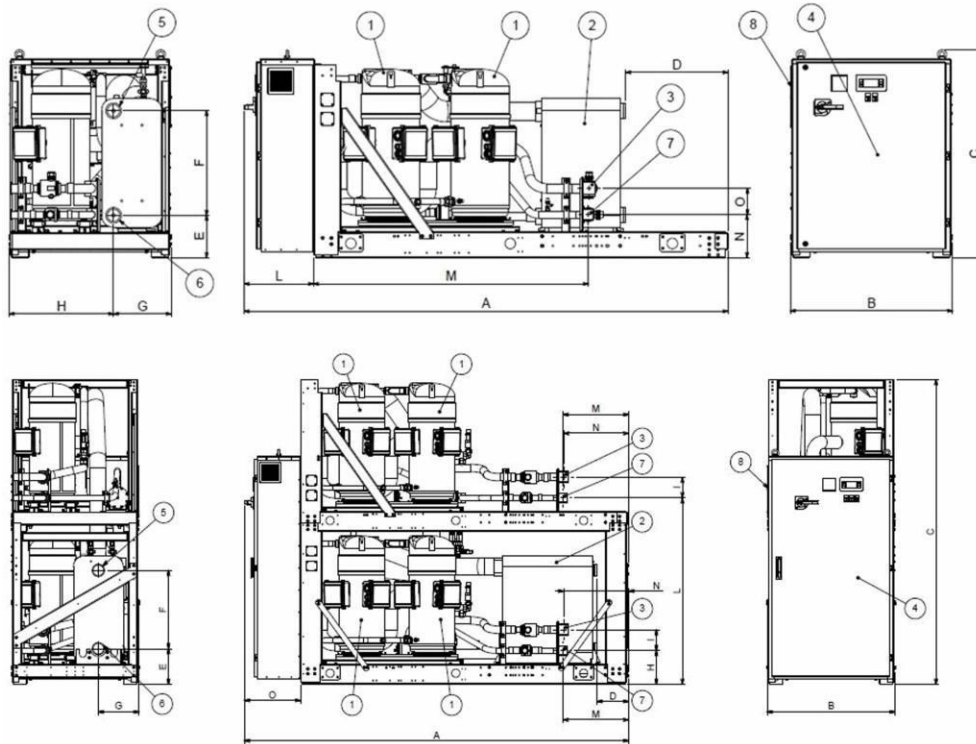

LEGEND

- 1: COMPRESSOR
- 2: EVAPORATOR
- 3: COMPRESSOR DISCHARGE
- 4: ELECTRICAL PANEL
- 5: EVAPORATOR WATER INLET CONNECTION (VICTAULIC AS OPTION)
- 6: EVAPORATOR WATER OUTLET CONNECTION (VICTAULIC AS OPTION)
- 7: LIQUID LINE INLET
- 8: POWER CONNECTIONS SLOT 150X200

| | A N | B O | C | D | E | F | G | H | I | L | M |
|-------------|--------|--------|------|-----|-----|-----|-----|-----|-----|------|------|
| EWLQ090G-SS | 2743 | 928 | 1066 | 736 | 227 | 470 | 221 | 707 | | 371 | 1573 |
| EWLQ100G-SS | 2743 | 928 | 1066 | 683 | 227 | 470 | 221 | 707 | | 371 | 1573 |
| EWLQ120G-SS | 2743 | 928 | 1066 | 822 | 231 | 450 | 273 | 655 | | 371 | 1573 |
| EWLQ130G-SS | 2743 | 928 | 1066 | 785 | 231 | 450 | 273 | 655 | | 371 | 1573 |
| EWLQ150G-SS | 2743 | 928 | 1066 | 757 | 231 | 450 | 273 | 655 | | 371 | 1573 |
| EWLQ170G-SS | 2743 | 928 | 1066 | 725 | 231 | 450 | 273 | 655 | | 371 | 1573 |
| EWLQ190G-SS | 2743 | 928 | 1066 | 692 | 231 | 450 | 273 | 655 | | 371 | 1573 |
| EWLQ210G-SS | 2743 | 928 | 1066 | 657 | 231 | 450 | 273 | 655 | | 371 | 1573 |
| EWLQ240G-SS | 2743 | 928 | 1066 | 657 | 231 | 450 | 273 | 655 | | 371 | 1573 |
| EWLQ300G-SS | 2743 | 928 | 1186 | 658 | 242 | 597 | 330 | 598 | | 371 | 1573 |
| EWLQ360G-SS | 2743 | 928 | 1186 | 585 | 242 | 597 | 330 | 598 | | 371 | 1573 |
| EWLQ180L-SS | 2801 | 928 | 1970 | 643 | 258 | 568 | 295 | 245 | 150 | 1352 | 395 |
| EWLQ205L-SS | 2801 | 928 | 1970 | 613 | 258 | 568 | 295 | 245 | 150 | 1352 | 395 |
| EWLQ230L-SS | 2801 | 928 | 1970 | 553 | 258 | 568 | 295 | 245 | 150 | 1352 | 448 |
| EWLQ260L-SS | 2801 | 928 | 1970 | 553 | 258 | 568 | 295 | 245 | 150 | 1352 | 448 |
| EWLQ290L-SS | 2801 | 928 | 1970 | 492 | 258 | 568 | 295 | 245 | 150 | 1352 | 448 |

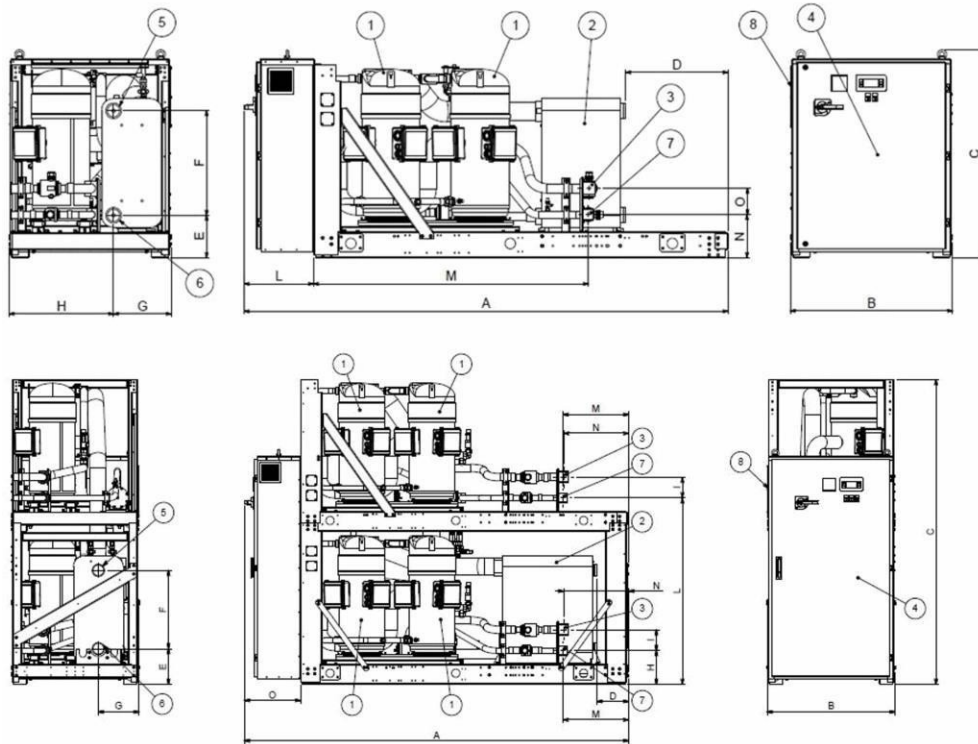

LEGEND

- 1: COMPRESSOR
- 2: EVAPORATOR
- 3: COMPRESSOR DISCHARGE
- 4: ELECTRICAL PANEL
- 5: EVAPORATOR WATER INLET CONNECTION (VICTAULIC AS OPTION)
- 6: EVAPORATOR WATER OUTLET CONNECTION (VICTAULIC AS OPTION)
- 7: LIQUID LINE INLET
- 8: POWER CONNECTIONS SLOT 150X200

| | A N | B O | C | D | E | F | G | H | I | L | M |
|-------------|--------|--------|------|-----|-----|-----|-----|-----|-----|------|-----|
| EWLQ330L-SS | 2801 | 928 | 1970 | 492 | 258 | 568 | 295 | 245 | 150 | 1352 | 448 |
| EWLQ380L-SS | 185 | 421 | 1970 | 432 | 258 | 568 | 295 | 245 | 150 | 1352 | 448 |
| EWLQ430L-SS | 2801 | 928 | 1970 | 351 | 258 | 568 | 295 | 245 | 150 | 1352 | 448 |
| EWLQ480L-SS | 185 | 421 | 1970 | 351 | 258 | 568 | 295 | 245 | 150 | 1352 | 448 |
| EWLQ540L-SS | 2801 | 928 | 2090 | 351 | 258 | 568 | 295 | 245 | 150 | 1352 | 468 |
| EWLQ600L-SS | 165 | 421 | 2210 | 230 | 258 | 568 | 295 | 245 | 150 | 1352 | 468 |
| EWLQ660L-SS | 2801 | 928 | 2210 | 230 | 258 | 568 | 295 | 245 | 150 | 1352 | 468 |
| EWLQ720L-SS | 165 | 421 | 2210 | 230 | 258 | 568 | 295 | 245 | 150 | 1352 | 468 |

Warning Installation and maintenance of the unit must be performed only by qualified personnel who have knowledge with local codes and regulations, and experience with this type of equipment. Must be avoided the unit installation in places that could be considered dangerous for all the maintenance operations.

Handling Avoid bumping and/or jolting during loading/unloading unit from the truck and moving it. Do not push or pull the unit from any part other than the basis. Secure the unit inside the truck to prevent it from moving and causing damages. Do not allow any part of the unit to fall during transportation or loading/unloading. Use extreme caution when handling the unit to prevent damage to the control or the refrigerant piping. The unit must be lifted by inserting a hook in each corner, where there are holes for lifting (see the following drawings instruction). During the lifting phase to verify that the ropes and / or the lifting chains do not touch the electrical panel and / or piping. If moving the machine, you had the sleds or skates, push only on the basis of the machine without touching the pipes of copper, steel, compressors and / or the electrical panel.

Location All units are designed for indoor installation. A leveled and sufficiently strong floor is required. If necessary, additional structural members should be provided to transfer the weight of the unit to nearest beams. Rubber-in-shear isolators can be furnished and field placed under each corner of the package. A rubber anti-skid pad should be used under isolators if hold-down bolts are not used. Vibration isolator in all water piping connected to the chiller is recommended to avoid straining the piping and transmitting vibration and noise.

Space requirements Every side of the machine must be accessible for all post-installation maintenance activities. The minimum space required is shown on the following drawing:

Acoustic protection When noise level must meet special requirements, it is necessary to pay the maximum attention to ensure the perfect insulation of the unit from the support base by applying appropriate vibration-dampening devices on the unit, on the water pipes and on the electrical connections.

Storage The environment conditions have to be in the following limits:

| | |
|------------------------------|--------------------|
| Minimum ambient temperature: | -20°C |
| Maximum ambient temperature: | +57°C |
| Maximum R.H.: | 95% not condensing |

The above recommended information are representative of a general installation. A specific evaluation should be done by the contractor case by case.

For complete information refer to the installation manual.

General The unit will be designed and manufactured in accordance with the following European directives:

- Construction of pressure vessel 97/23/EC (PED)
- Machinery Directive 2006/42/EC
- Low Voltage 2006/95/EC
- Electromagnetic Compatibility 2004/108/EC
- Electrical & Safety codes EN 60204-1 / EN 60335-2-40
- Manufacturing Quality Standards UNI – EN ISO 9001:2004

To avoid any losses, the unit will be tested at full load in the factory (at the nominal working conditions and water temperatures). The chiller will be delivered to the job site completely assembled and charged with refrigerant and oil. The installation of the chiller must comply with the manufacturer's instructions for rigging and handling equipment.

The unit will be able to start up and operate (as standard) at full load with:

- evaporator leaving fluid temperature between °C and..... °C
- condensing temperature..... °C

Refrigerant Only HFC 410A can be used.

Performance The unit shall supply the following performances:

- Number..... unit(s)
- Cooling capacity for single unit.....kW
- Power input for single chiller in cooling mode.....kW
- Evaporator heat exchanger entering water temperature in cooling mode °C
- Evaporator heat exchanger leaving water temperature in cooling mode..... °C
- Evaporator heat exchanger water flowl/s

Operating voltage range should be 400V ±10%, 3ph, 50Hz, voltage unbalance maximum 3%, without neutral conductor and shall only have one power connection point.

Unit description The unit shall include as standard: one or two refrigerant circuit, two or four hermetic type rotary scroll compressors (according to the capacity), electronic expansion device (EEXV), refrigerant direct expansion plate to plate heat exchangers, R-410A refrigerant, motor starting components, control system and all components necessary for a safe and stable unit operation. The chiller will be factory assembled on a robust base frame made of galvanized steel, protected by an epoxy paint.

Sound level and vibrations Sound pressure level at 1 meter distance in free field, hemispheric conditions, shall not exceeddB(A). The sound pressure levels must be rated in accordance to ISO 3744 (other types of rating can not be used). Vibration on the base frame should not exceed 2 mm/s.

Dimensions Unit dimensions shall not exceed following indications:

- Unit lengthmm
- Unit widthmm
- Unit heightmm

Compressors The units shall be equipped with:

- High performance hermetic scroll compressors optimized to work with R410a, with reduced vibration and sound emissions. High efficiency values shall be guaranteed:
 - by high volumetric efficiency in the whole range of application, through the continuous contact between the fixed and the orbiting scroll deleting the dead space and the re-expansion of the refrigerant gas;
 - by low pressure drops due to the absence of inlet and discharge valves and to the uniform compression cycle;
 - reduction of the heat exchange between the gas during suction and discharge due to the separation of gas flows;
- The reduced noise shall be obtained:-for the absence of the inlet and discharge valves
 - for the uniform compression cycle
 - for the absence of pistons which ensures reduced vibration and pulsation of the refrigerant
- The engine shall be cooled by the suction refrigerant fluid.
- The terminal shall be contained in a casing with protection degree IP 54.
- The compressors shall be provided with crankcase heater to prevent the dilution of refrigerant and oil the during the stops of the unit;
- Shall be present an electronic thermal protection for the three phases complete with sensors on the stator windings to avoid overheating caused by lack of phase, insufficient cooling, mechanical locks, power supply out of tolerance;
- The compressors shall be connected in Tandem on a single refrigerating circuit.
- The compressors shall be fitted on rubber antivibration mounts.
- The compressors shall be provided complete with oil charge.

Evaporator (PHE) The units shall be equipped with a direct expansion plate to plate type evaporator.

- The evaporator will be made of stainless steel brazed plates closed cell polyurethane insulation material (20-mm thick).
- The evaporator will have 1 or 2 refrigerant circuit.
- The evaporator will be manufactured in accordance to PED approval.
- Flow switch must be installed on plant.
- Water filter must be installed on plant.

Refrigerant circuit The unit shall have one or two refrigerant circuits according to the capacity.

- The circuits shall include as standard: electronic expansion device piloted by unit's microprocessor control, liquid line shut-off valve, sight glass with moisture indicator, filter drier, charging valves, high pressure switch, high and low pressure transducers and insulated suction line.

Condensation control The controller automatically unloads the circuit when abnormal high condensing pressure is detected. This to prevent the shutdown of the refrigerant circuit (shutdown of the unit) due to a high pressure fault.

Hydronic kit options (on request) The hydronic module shall be integrated in the unit chassis without increasing its dimensions and includes the following elements: centrifugal pump with motor protected by a circuit breaker installed in control panel with pressure gauge, safety valve, drain valve.

- The hydronic module shall be assembled and wired to the control panel.
- The water piping shall be protected against corrosion and insulated to prevent condensation.

Electrical control panel Power and control shall be located in the main panel that will be manufactured to ensure protection against all weather conditions.

- The electrical panel shall be IP54 and (when opening the doors) internally protected against possible accidental contact with live parts.
- The main panel shall be fitted with a main switch interlocked door that shuts off power supply when opening.
- The power section will include compressors and fans protection devices, compressors and fans starters and control circuit power supply.

Controller The controller will be installed as standard and it will be used to modify unit set-points and check control parameters.

- A built-in display will show chiller operating status plus temperatures and pressures of water, refrigerant and air, programmable values, set-points.
- A sophisticated software with predictive logic, will select the most energy efficient combination of compressors, EEXV and condenser fans to keep stable operating conditions to maximize chiller energy efficiency and reliability.
- The controller will be able to protect critical components based on external signals from its system (such as motor temperatures, refrigerant gas and oil pressures, correct phase sequence, pressure switches and evaporator). The input coming from the high pressure switch cuts all digital output from the controller in less than 50ms, this will be an additional security for the equipment.
- Fast program cycle (200ms) for a precise monitoring of the system.

Controller main features Controller shall be guarantee following minimum functions:

- Management of the circuit capacity.
- Chiller enabled to work in partial failure condition (for 2 circuit units).
- Full routine operation at condition of:
 - high thermal load
 - high evaporator entering water temperature (start-up)
- Display of evaporator entering/leaving water temperature.
- Display of condensing-evaporating temperature and pressure, suction superheat for each circuit.
- Leaving water evaporator temperature regulation.
- Compressor and evaporator pumps hours counter.
- Display of Status Safety Devices.
- Number of starts and compressor working hours.
- Optimized management of compressor load.
- Fan management according to condensing pressure (for condenserless units).
- Re-start in case of power failure (automatic / manual).
- Soft Load (optimized management of the compressor load during the start-up).
- Start at high evaporator water temperature.
- Return Reset (Set Point Reset based on return water temperature).
- Set point Reset (optional).
- Application and system upgrade with commercial SD cards.
- Ethernet port for remote or local servicing using standard web browsers.

High Level Communications Interface (on request) The chiller shall be able to communicate to BMS (Building Management System) based on the most common protocols as:

- ModbusRTU
- LonWorks, now also based on the international 8040 Standard Chiller Profile and LonMark Technology
- BacNet BTP certified over IP and MS/TP (class 4) (Native)
- Ethernet TCP/IP.



The present leaflet is drawn up by way of information only and does not constitute an offer binding upon Daikin Europe N.V. Daikin Europe N.V. has compiled the content of this leaflet to the best of its knowledge. No express or implied warranty is given for the completeness, accuracy, reliability or fitness for particular purpose of its content and the products and services presented therein. Specifications are subject to change without prior notice. Daikin Europe N.V. explicitly rejects any liability for any direct or indirect damage, in the broadest sense, arising from or related to the use and/or interpretation of this leaflet. All content is copyrighted by Daikin Europe N.V.



www.eurovent-certification.com
www.certiflash.com

Daikin products are distributed by: